

分類/Classification	<input checked="" type="checkbox"/> tDS/tGW/tSH	<input type="checkbox"/> PETL/tET/tPET	<input type="checkbox"/> DS/PDS/PPDS	<input type="checkbox"/> tM-752N	
	<input type="checkbox"/> I/O Card	<input type="checkbox"/> VXC Card	<input type="checkbox"/> TouchPAD/HMIWorks	<input type="checkbox"/> VxComm	
作者/Author	Tammy	日期/Date	2017-08-09	編號/No.	FAQ046

Q: How do I connect two tSH-735 sharers with a master through the same RS-485 bus?

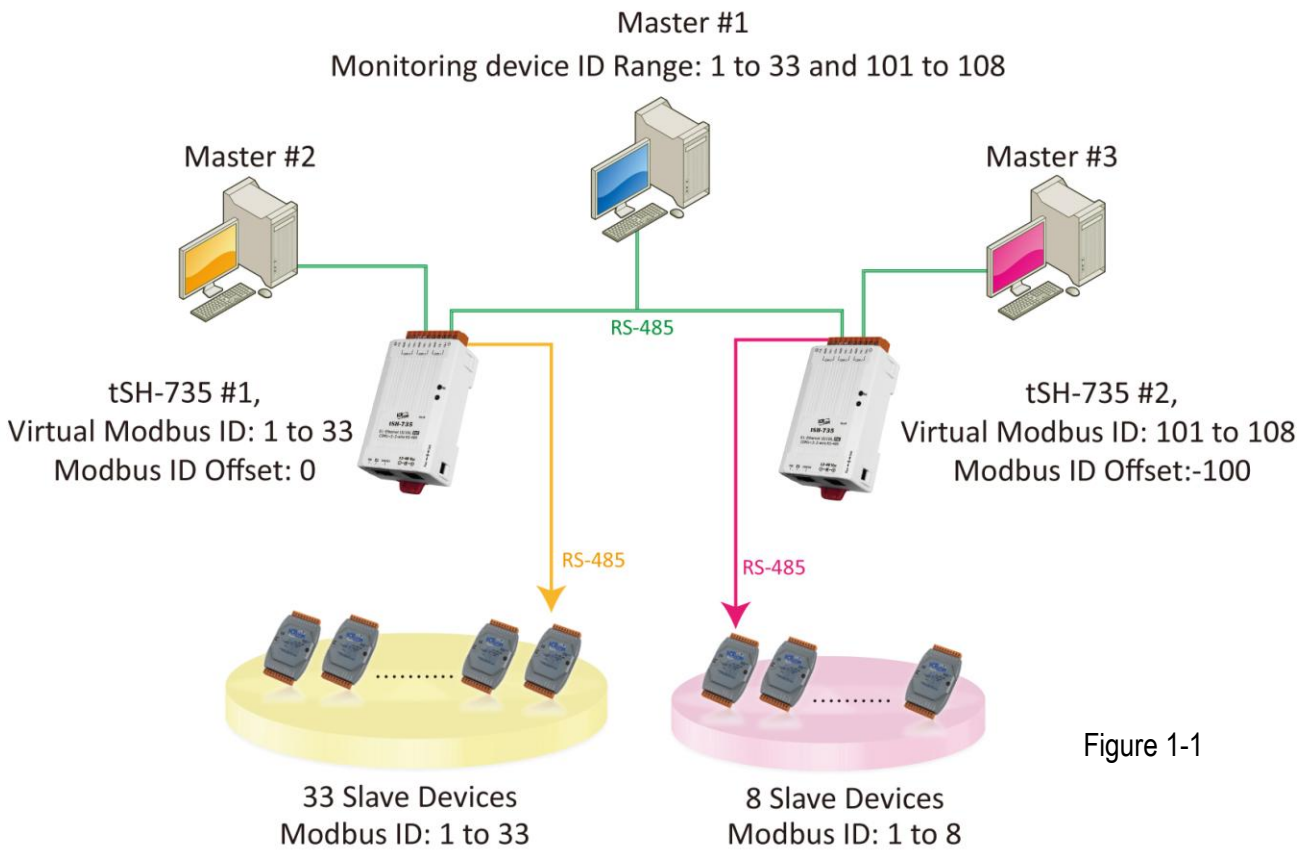


Figure 1-1

As illustrated in the application diagram above, Figure 1-1, two tSH-735 sharers are connected together to a monitoring computer (master device), and multiple slave devices are connected to the two sharers. However, this means that the Modbus IDs are duplicated. To reduce the possibility of adverse interactions between the two sharers, we need to configure them so that they are composed of two individual "Virtual Modbus ID" ranges. This means that sharer #1 will process the requests addressed to Modbus ID range #1, and sharer #2 will process requests addressed to Modbus ID range #2. To achieve this, we need to use the "Modbus ID Offset" setting, which allows us to align the virtual IDs to the physical IDs. The following is a detailed description of the configuration process, together with recommended precautions that should be taken when establishing this form of configuration:

1. Ensure that you use a **DC power supply**. Using a PoE power supply may cause current loop problems in this application. Note, however, that isolated tSH-735i modules can be used with a PoE power supply in this example application.
2. Note that **raw data mode is not supported** in this example application.

Configure tSH-735 module #1:

Step 1: Before beginning, confirm that both the Ethernet connection and the tSH-735 module are functioning correctly. For detailed information regarding how to install, configure and operate your tSH-735 module, refer to the tSH-700 Quick Start Guide, which can be downloaded from:



[Download the Quick Start Guide.](#)

Step 2: Execute the eSearch Utility to search for any tSH-700 modules connected to the network, and then click the name of the tSH-735 module #1 to select it.

Step 3: Click the **“Web”** button to log in to the web configuration pages for tSH-735 module #1 (use the default password **“admin”**), or enter the URL of tSH-735 module #1 in the address bar of the browser.

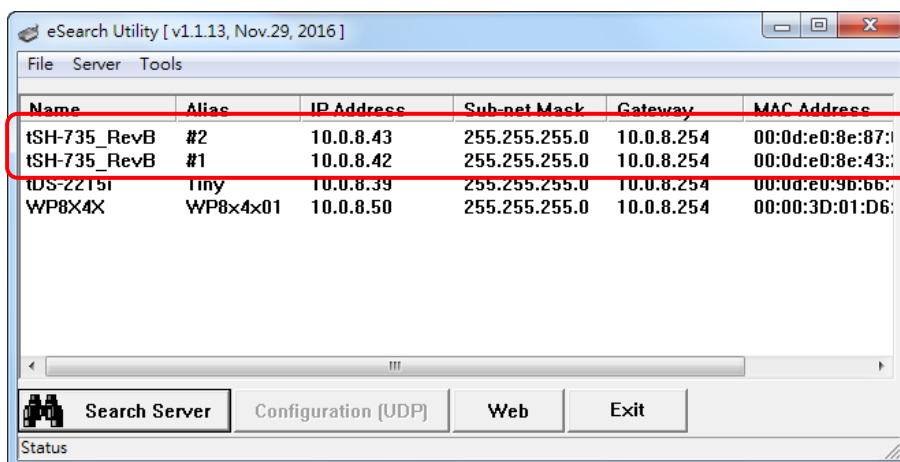


Figure 1-2

Step 4: Once you have successfully logged into the web configuration pages for tSH-735 module #1, click the **“Application Mode”** tab to display the **Application Mode Settings** page.

Step 5: On the **Application Mode Settings** page, check the **“Mode 2: Modbus Sharer”** option and then select the appropriate radio button for the COM Port on tSH-735 module #1 that the slave devices are connected to from the **“Slave Device Connected on:”** options.

Step 6: Enter **“1 to 33”** in the relevant **Virtual Modbus ID** fields.

Step 7: Enter **“0”** in the **Modbus ID Offset** field and click the **“Submit”** button to save your settings.

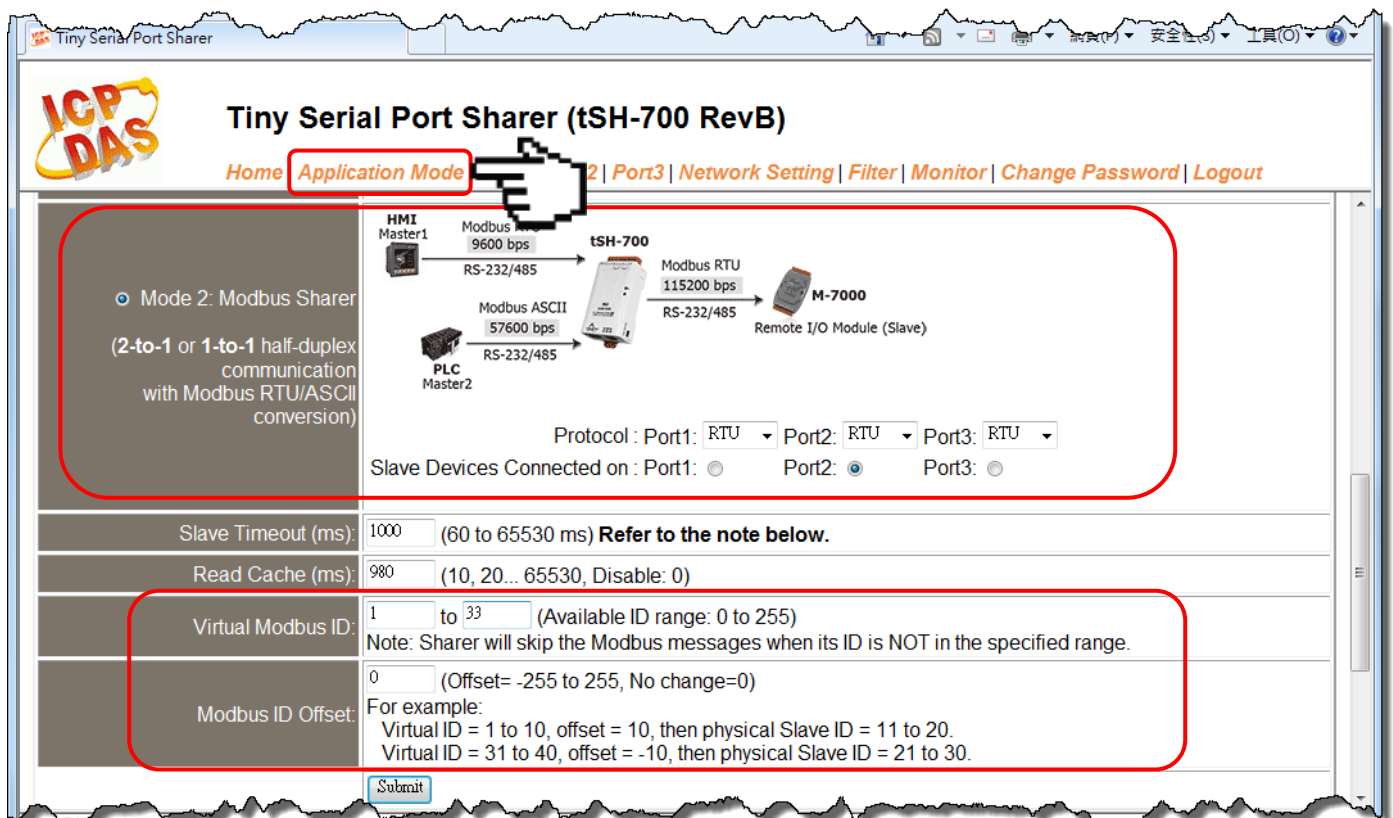


Figure 1-3

! Note: Remember to check that the Baud Rate and data format settings for each serial port on the tSH-700 module are the same as those for your master and slave devices.

Configure tSH-735 module #2:

Step 8: In the eSearch Utility, click the name of tSH-735 module #2 to select it, and then click the “Web” button to log in to the web configuration pages for tSH-735 module #2 (use the default password “admin”), or enter the URL of tSH-735 module #2 in the address bar of the browser.

Step 9: Once you have successfully logged into the web configuration pages for tSH-735 module #2, click the “Application Mode” tab to display the **Application Mode Settings** page.

Step 10: On the **Application Mode Settings** page, check the “Mode 2: Modbus Sharer” option and select the appropriate radio button for the COM Port on tSH-735 module #2 that the slave devices are connected to from the “Slave Device Connected on:” options.

Step 11: Enter “101 to 108” in the relevant **Virtual Modbus ID** fields.

Step 12: Enter “-100” in the **Modbus ID Offset** field and click the “Submit” button to save your settings.

Tiny Serial Port Sharer (tSH-700 RevB)

Home | **Application Mode** | #2 | Port3 | Network Setting | Filter | Monitor | Change Password | Logout

Mode 2: Modbus Sharer
 (2-to-1 or 1-to-1 half-duplex communication with Modbus RTU/ASCII conversion)

Protocol : Port1: RTU Port2: RTU Port3: RTU
 Slave Devices Connected on : Port1: Port2: Port3:

Slave Timeout (ms): 1000 (60 to 65530 ms) Refer to the note below.

Read Cache (ms): 980 (10, 20... 65530, Disable: 0)

Virtual Modbus ID: 101 to 108 (Available ID range: 0 to 255)
 Note: Sharer will skip the Modbus messages when its ID is NOT in the specified range.

Modbus ID Offset: -100 (Offset= -255 to 255, No change=0)
 For example:
 Virtual ID = 1 to 10, offset = 10, then physical Slave ID = 11 to 20.
 Virtual ID = 31 to 40, offset = -10, then physical Slave ID = 21 to 30.

Submit

Figure 1-4

! Notes:

- Remember to check that the Baud Rate and data format settings for each serial port on the tSH-700 module are the same as those for your master and slave devices.
- Once the three Modbus masters have been correctly configured, they will then be able to access the slave devices using the specified Virtual Modbus IDs, rather than the physical Modbus IDs, thereby avoiding any problems with duplicated Modbus IDs.