

Classification	UA-Series English Function Wizard FAQ-dbl-05							
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	1 / 17	


**FAQ-DBL-05: UA Web UI Function Wizard – Data Log -
How to set up remote database function: Modbus RTU / MySQL(MariaDB) ? (Use M-7026)**

UA series supports Data Logger function. Its Local Data Logger can save I/O data log to local CSV file, and record I/O status at the scheduled time. Furthermore, users can set the time interval of which CSV file to generate and divide on the local side. Its Remote Database can import I/O data collection directly into the remote SQL database, e.g. MS SQL, MySQL, MariaDB ..., for the Big Data analysis.

UA Data Logger supports to collect devices I/O status and then directly write into **remote side MySQL /MariaDB Database** for the Big Data analysis.

The connection steps for **MySQL and MariaDB** is the same, so here will introduce them together. The Modbus / MySQL and MariaDB Remote Database settings include Modbus RTU and TCP. Here will introduce **Modbus RTU** as the setting sample.

- Modbus RTU / Remote Database MySQL(MariaDB)**

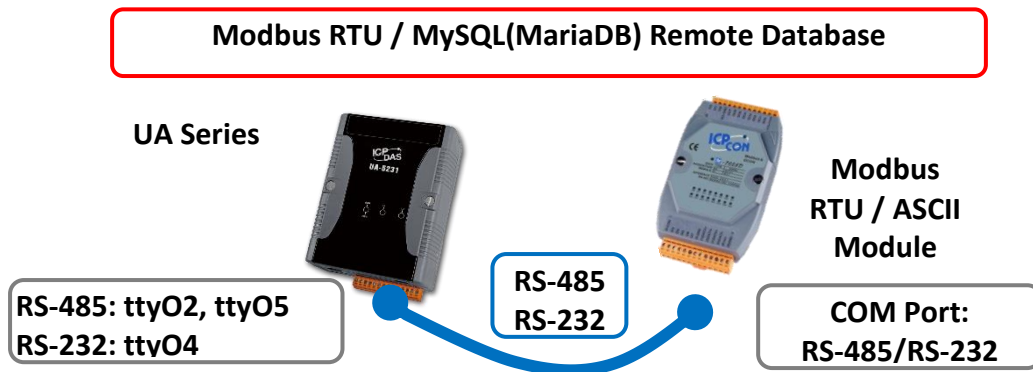

Note: The hardware/network connection methods please see the UA Manual [Chapter 2](#).


When UA series controller connects the Modbus RTU module (via RS-485/232, as the picture), user can choose the item [**Modbus RTU / MySQL(MariaDB)**] of the “Data Log” in the Function Wizard.

<p>Data Log</p> <p>(Master) Modbus RTU / Local Data Logger</p> <p>(Master) Modbus TCP / Local Data Logger</p> <p>(Master) Modbus RTU / MS SQL</p> <p>(Master) Modbus TCP / MS SQL</p> <p>(Master) Modbus RTU / MySQL(MariaDB)</p> <p>(Master) Modbus TCP / MySQL(MariaDB)</p>

Classification	UA-Series English Function Wizard FAQ-dbl-05						
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	2 / 17

[Step Box]:


The Step Box of the [**Modbus RTU / MySQL(MariaDB)**] has 6 steps. When enabling the Step Box, it auto enters the first step setting page (The step with a bold underline means it is the current step.). The user just needs to follow the “Step Box” step-by-step and then can complete the project quickly and rightly.

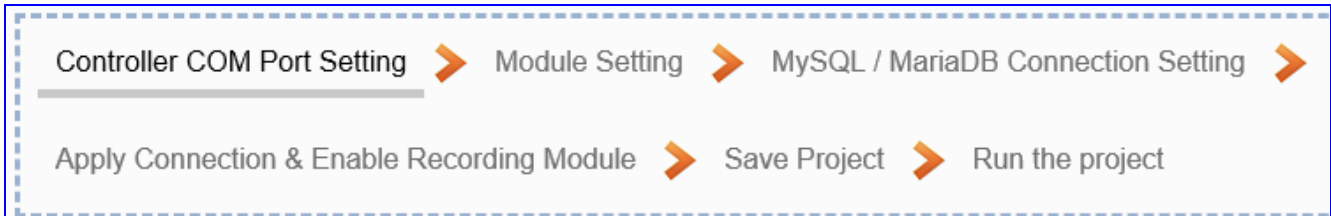


This example: UA-5231M-4GE via ttyO2 port to connect the device M-7026.

Classification	UA-Series English Function Wizard FAQ-dbl-05							
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	3 / 17	

● **Step 1. Controller COM Port Setting**

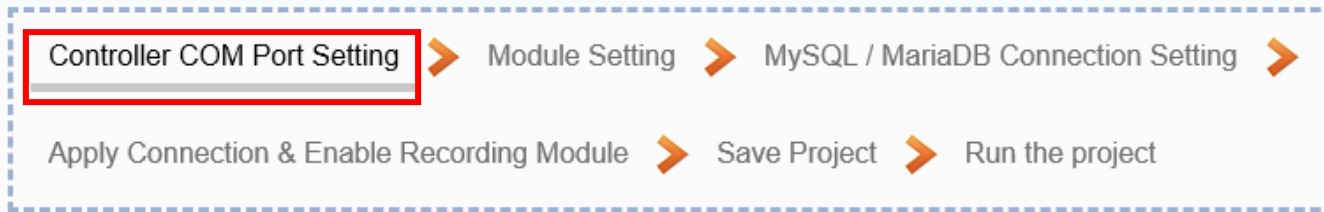


This page allows display and set the COM port interface of the controller for the RS-232/RS-485 serial communication. The user can find the default communication values of our I/O modules from the module CD, manual or [I/O Module website](#).

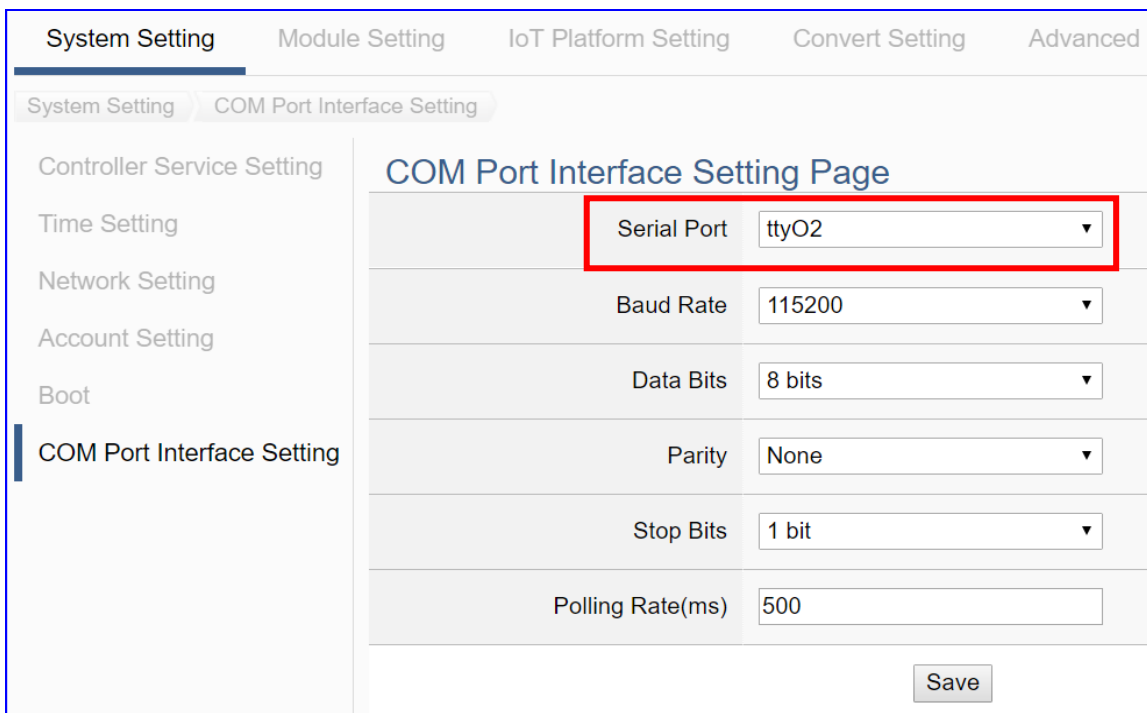

COM Port Interface Setting Page	
Serial Port	Choose the serial port of UA controller that links with the I/O module. ttyO2: RS-485 ; ttyO4: RS-232 ; ttyO5: RS-485
Baud Rate	Choose a baud rate to communicate with the module: 1200, 2400, 4800, 9600, 19200, 38400, 57600 and 115200. The UA controller and the I/O module need have the same baud rate.
Data Bits	The number of bits used to represent one byte of data: 7 bits or 8 bits. Default: 8 Bits.
Parity	Choose one way for the parity checking. Options: None, Even, and Odd. Default: None.
Stop Bits	Choose the number of stop bit: 1 bit or 2 bits. Default: 1.
Polling Rate(ms)	Set a time interval for the command. Default: 500 ms
Save	Click [Save] button could save the settings of this page.

Classification	UA-Series English Function Wizard FAQ-dbl-05							
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	4 / 17	

● **Step 2. Module Setting**

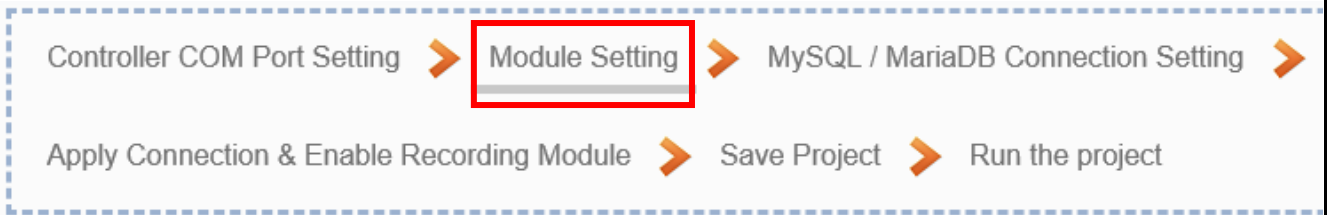

It auto-enter the first step, **Step 2 [Module Setting]** of the UI setting.

This page is for setting the communication values with the connected modules. First check the port that connected with the module, and each module can give a name (Default name: Name). Click [+] button could add a new module, and then click [Edit] button to configure the module content and the Modbus mapping table.

The module (Ex: **M-7026**) is as below, and then click [Edit] button to enter the “Module Content Setting” page.

If set up a wrong module, user can click the box in the left side of the module number and click the [Remove] button to delete the module.

Classification	UA-Series English Function Wizard FAQ-dbl-05						
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	5 / 17

[**Module Content Setting**] page can set up the module and the Modbus mapping table:

Module Content Setting

No.	3
Module Name	M-7026
Slave ID	2
Timeout(ms)	500

Modbus Mapping Table Setting

Data Model	01 Coil Status(0x)
Start Address	0
Data Number	1
Create Tables	<input type="button" value="Add"/>

Example: M-7026

For ICP DAS module, system will auto setup the Modbus Mapping Table; if not, user needs to check the Modbus address or I/O number from the module user manual.

[Slave ID] 2 (by user's real case)
[Modbus Mapping Table Setting]
Data Model: 04 Input Registers(3x)
Start Address: 0
Data Number: 6
Type: 16-bit Short
→ Click [Add]

Module Content Setting	
No.	The module number in the module list (Not editable here)
Module Name	Give a name, e.g. model number or name. Default: Name.
Slave ID	Set the module Slave ID of the UA. (Range: 1 ~ 247)
Timeout	Set the timeout value for the module. Default: 500 ms
Modbus Mapping Table Setting	
Data Model	System provides 4 Modbus data models "01" ~ "04" for mapping to address of DO, DI, AO and AI. (ex. 01: DO channels, 02: DI, 03: AO, 04: AI) <div style="float: right; border: 1px solid gray; padding: 2px; margin-top: 5px;"> 01 Coil Status(0x) 02 Input Status(1x) 03 Holding Registers(4x) 04 Input Registers(3x) </div>
Start Address	The start address of the Modbus command. Note: the Start Address of UA is bass on 0, even if some modules are bass on 1, here it needs to follow UA to set bass on 0.
Data Number	The number of the Modbus address. Need to give enough number for the DO, DI, AO, AI channels of the module. Default: 1.
Type	This item only when the data model is 03 or 04. Choose the suitable data type: 16-bit Short, 16-bit Unsigned Short, 32-bit Long, 32-bit Unsigned Long, 32-bit Float, 64-bit Double.
Create Tables	Click [Add] button, it will add a table in the Modbus mapping table.

Classification	UA-Series English Function Wizard FAQ-dbl-05						
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	6 / 17

The finished Modbus Mapping Table as below is in order of mapping DO, DI, AO & AI.

Address:

Display and edit the Modbus Mapping Table.

Modbus Mapping Table		Address	Nickname	Scaling	Bitwise		
Coil Status(0x)		Input Status(1x)		Holding Registers(4x)		Input Registers(3x)	
Address	0	Address	32	Address	32	Address	0
Number	3	Number	3	Number	2	Number	6
Type	Bool	Type	Bool	Type	Short	Type	Short
<input type="button" value="Edit"/>		<input type="button" value="Edit"/>		<input type="button" value="Edit"/>		<input type="button" value="Edit"/>	
<input type="button" value="OK"/>				<input type="button" value="Cancel"/>			

Modbus Mapping Table – Address Setting	
Address Setting	The “Address Setting” page of the Modbus Mapping Table
Nickname Setting	Click can switch to the The “Nickname Setting” page of the Modbus Mapping Table. (Next page)
Modbus Mapping Table	Coil Status(0x): Mapping to DO Modbus address Input Status(1x): Mapping to DI Modbus address Holding Registers(4x): Mapping to AO Modbus address Input Registers(3x): Mapping to AI Modbus address
Address	The start address of the Modbus command. Default: 0. Note: the Start Address of UA is bass on 0, even if some modules are bass on 1, here it needs to follow UA to set bass on 0.
Number	The number of the Modbus address. Need to give enough number for the DO, DI, AO, AI channels of the module. At least 1.
Type	DO/DI type: Bool (Boolean) AO/AI type: depend on setting of [Modbus Mapping Table Setting]
Edit	Click to change the address and Number.
Delete	Click to delete this address table.
Save	Click to save and exit this table editing.
Cancel	Click to exit without saving and back to the module list page.
OK	Click to save this page settings and back to the module list page.

Classification	UA-Series English Function Wizard FAQ-dbl-05						
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	7 / 17

Nickname:

Setting the variable nickname and description.

Modbus Mapping Table | Address | Nickname | Scaling | Bitwise

01 Coil Status(0x)

Table Display Show Hide

Address	Variable name	Data Type	Description
0	<input type="text" value="DO0"/>	Bool	<input type="text"/>
1	<input type="text" value="DO1"/>	Bool	<input type="text"/>
2	<input type="text" value="DO2"/>	Bool	<input type="text"/>

02 Input Status(1x)

Table Display Show Hide

Address	Variable name	Data Type	Description
32	<input type="text" value="DI32"/>	Bool	<input type="text"/>
33	<input type="text" value="DI33"/>	Bool	<input type="text"/>
34	<input type="text" value="DI34"/>	Bool	<input type="text"/>

03 Holding Registers(4x)

Table Display Show Hide

Address	Variable name	Data Type	Swap	Description
32	<input type="text" value="AO32"/>	Short	<input type="checkbox"/>	<input type="text"/>
33	<input type="text" value="AO33"/>	Short	<input type="checkbox"/>	<input type="text"/>

04 Input Registers(3x)

Table Display Show Hide

Address	Variable name	Data Type	Swap	Description
0	<input type="text" value="AI0"/>	Short	<input type="checkbox"/>	<input type="text"/>
1	<input type="text" value="AI1"/>	Short	<input type="checkbox"/>	<input type="text"/>

Modbus Mapping Table – Nickname Setting	
Modbus Mapping Table	Coil Status(0x): Mapping to DO Modbus address Input Status(1x): Mapping to DI Modbus address Holding Registers(4x): Mapping to AO Modbus address Input Registers(3x): Mapping to AI Modbus address
Table Display	Click [Show] to display all fields, click [Hide] to hide some fields.
Address	Modbus address. System auto arrange.
Variable name	The variable name of the mapping address. Default: Tag0 and auto arrange the number. User can define the name.
Data Type	Display data type of the variable. (Not editable)
Swap	Check to swap the byte order (Lo-Hi/Hi-Lo) for 4-byte or 8-byte.
Description	Write a note for this variable.
OK	Click to save this page settings and back to the module list page.

Classification	UA-Series English Function Wizard FAQ-dbl-05							
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	8 / 17	

Scaling:

Scaling is only available in the AI/AO settings of Modbus RTU/TCP. When the variable value needs to be scaled or converted before output, click the **"Advanced Setting"** button of the variable on the **Scaling** page, input the **Min./Max./Offset** of the Reference/Output items, add a description, and check **"Enable"** box, The Scaling conversion function will be activated.

Modbus Mapping Table		Address	Nickname	Scaling	Bitwise
03 Holding Registers(4x)					
Table Display		<input type="button" value="Show"/> <input type="button" value="Hide"/>			
Address	Reference	Output	Scaling	Enable	Description
32	<input type="text" value="AO32"/>	<input type="text" value="Scale_AO32"/>	<input type="button" value="Show Detail"/>	<input type="checkbox"/>	<input type="text"/>
33	<input type="text" value="AO33"/>	<input type="text" value="Scale_AO33"/>	<input type="button" value="Show Detail"/>	<input type="checkbox"/>	<input type="text"/>
04 Input Registers(3x)					
Table Display		<input type="button" value="Show"/> <input type="button" value="Hide"/>			
Address	Reference	Output	Scaling	Enable	Description
0	<input type="text" value="AI0"/>	<input type="text" value="Scale_AI0"/>	<input type="button" value="Show Detail"/>	<input type="checkbox"/>	<input type="text"/>

Modbus Mapping Table – Scaling

Modbus Mapping Table	Holding Registers(4x): Mapping to AO Modbus address Input Registers(3x): Mapping to AI Modbus address Scaling do not support 01 Coil Status(0x):DO & 02 Input Status(1x):DI
Table Display	Click [Show] to display all fields, click [Hide] to hide some fields.
Address	Modbus address. System auto arrange.
Reference	The I/O variable of the Modbus address.
Output	The scaling variable for scaling output. User can define the variable name.
Scaling	Click [Show Detail] to set up the Scaling parameters, and click [Hide Detail] to hide the parameters. Fill in the Min/Max range values of the source in the Reference column. Fill in the Min/Max range values after scaling in the Output column. If needs offset, fill the offset value in the Offset item. Remember check "Enable" box.
Enable	Check the box of the variable can enable just that variable for scaling.
Description	Write a note for this variable.
OK	Click to save this page settings and back to the module list page.

Classification	UA-Series English Function Wizard FAQ-dbl-05							
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	9 / 17	

Bitwise:

Bitwise is only available in the AI/AO settings of Modbus RTU/TCP. When the data needed to take out the value of the specified bit, fill in the variable name in the specified Bit# of the required address, and the value of the bit can be output to the filled variable.

Modbus Mapping Table
Address
Nickname
Scaling
Bitwise

03 Holding Registers(4x)

Table Display
Show
Hide

Address	Reference	Bitwise
32	AO32	Show Detail
	AO33	Hide Detail
33	<div style="display: flex; flex-direction: column; gap: 5px;"> <div style="display: flex; align-items: center;">Bit0 <input style="width: 80px;" type="text"/></div> <div style="display: flex; align-items: center;">Bit2 <input style="width: 80px;" type="text"/></div> <div style="display: flex; align-items: center;">Bit4 <input style="width: 80px;" type="text"/></div> <div style="display: flex; align-items: center;">Bit6 <input style="width: 80px;" type="text"/></div> <div style="display: flex; align-items: center;">Bit8 <input style="width: 80px;" type="text"/></div> <div style="display: flex; align-items: center;">Bit10 <input style="width: 80px;" type="text"/></div> <div style="display: flex; align-items: center;">Bit12 <input style="width: 80px;" type="text"/></div> <div style="display: flex; align-items: center;">Bit14 <input style="width: 80px;" type="text"/></div> </div>	<div style="display: flex; flex-direction: column; gap: 5px;"> <div style="display: flex; align-items: center;">Bit1 <input style="width: 80px;" type="text"/></div> <div style="display: flex; align-items: center;">Bit3 <input style="width: 80px;" type="text"/></div> <div style="display: flex; align-items: center;">Bit5 <input style="width: 80px;" type="text"/></div> <div style="display: flex; align-items: center;">Bit7 <input style="width: 80px;" type="text"/></div> <div style="display: flex; align-items: center;">Bit9 <input style="width: 80px;" type="text"/></div> <div style="display: flex; align-items: center;">Bit11 <input style="width: 80px;" type="text"/></div> <div style="display: flex; align-items: center;">Bit13 <input style="width: 80px;" type="text"/></div> <div style="display: flex; align-items: center;">Bit15 <input style="width: 80px;" type="text"/></div> </div>

04 Input Registers(3x)

Table Display
Show
Hide


Address	Reference	Bitwise
---------	-----------	---------

Modbus Mapping Table – Bitwise

Modbus Mapping Table	Holding Registers(4x): Mapping to AO Modbus address Input Registers(3x): Mapping to AI Modbus address Bitwise do not support 01 Coil Status(0x):DO & 02 Input Status(1x):DI Bitwise do not supports 32-bit Float & 64-bit Double data types.
Table Display	Click [Show] to display all fields, click [Hide] to hide some fields.
Address	Modbus address. System auto arrange.
Reference	The Bit# variables of the Modbus address.
Bitwise	Set up the variables for Bitwise. Click [Advanced Settings] to set up the Bitwise parameters, and click [Hide] to hide the parameters. Fill in the variable names to the Bit# that wanted to do the Bitwise. The value in the fixed bit number will be assigned into the variable.
OK	Click to save this page settings and back to the module list page.


Classification	UA-Series English Function Wizard FAQ-dbl-05						
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	10 / 17

● **Step 3. MySQL/MariaDB Connection Setting**

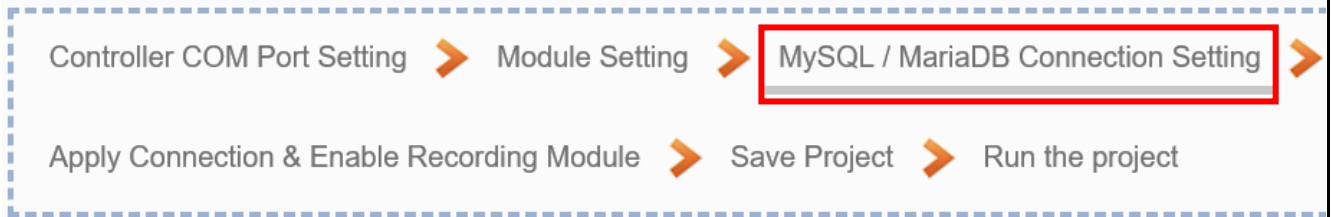


Click the next step, and enter the **Step 3 [MySQL/MariaDB Connection Setting]** of the UI setting. This page is for setting the connecting remote database.

We select the “Modbus TCP / Remote Database” at the beginning, so this step will auto enter the [Advanced Setting > Data Logger > MySQL / MariaDB] Setting. The “Step Box” will prevent the user from selecting the wrong platform.

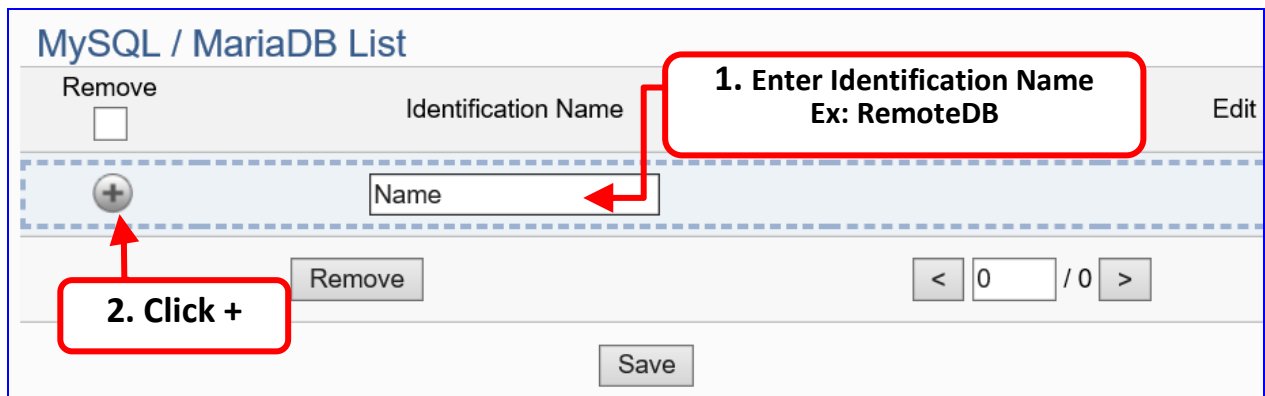

Add a database identification name (Ex: RemoteDB) as below, and then click [Edit] button to enter the “MySQL / MariaDB Content Setting” page.

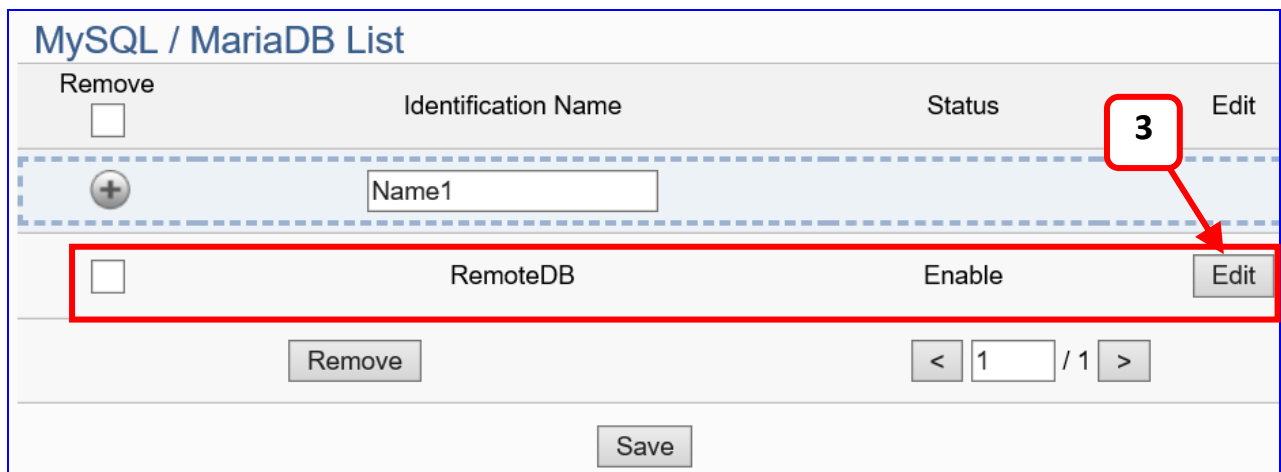

If set up a wrong module, user can click the box in the left side of the module number and click the [Remove] button to delete the module.

Classification	UA-Series English Function Wizard FAQ-dbl-05						
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	11 / 17

[MySQL / MariaDB Content Setting] can set up the database relational setting.


MySQL / MariaDB Connection Settings

Identification Name	<input type="text" value="ICPDAS_Cycle_DateTime"/>
Database Name	<input type="text" value="ICPDAS"/>
Table Name	<input type="text" value="Module_All_DateTime"/>
IP	<input type="text" value="192.168.85.11"/>
Port	<input type="text" value="3306"/>
Account	<input type="text" value="chris"/>
Password	<input type="password" value="****"/>
Log Mode	<input type="text" value="Cycle"/> ▼
Interval Seconds	<input type="text" value="5"/>
Date Time Format	<input type="text" value="[yyyy-MM-dd HH:mm:ss]"/> ▼
Enable	<input checked="" type="checkbox"/>
Test Connection	<input type="button" value="Connection"/>

Advanced Setting > Data Logger > MySQL/MariaDB – Content Settings	
Identification Name	User defined name to identify the database.
Database Name	The name of the remote database. If it does not exist, it will add a new database with this name.
Table Name	The table name of the remote database. If it does not exist, it will add a new table with this name.
IP	The Server IP and name of the remote database.
Port	The port to connect with database. Default: 3306 (for MySQL/MariaDB)
Account	The login name of the remote database.
Password	The login password of the remote database.
Log Mode	Cycle: Record one log data at the interval time set below. Data Change: Only record when the data has changed.
Interval Seconds	Set up the interval time to save the I/O data to the remote database. Unit: Second.
Date Time Format	Select to separate the date and time into two [Columns] or combine the date and time in one [Column].
Enable	Check to enable the data logger to the remote database. Default: check.
Test Connection	Click to test the connection to the remote database. Result: Success or Failure.
OK / Cancel	Click "OK" to save the settings of this page. Click "Cancel" to exit the setting page without saving.

Classification	UA-Series English Function Wizard FAQ-dbl-05							
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	12 / 17	


● **Step 4. Apply Connection & Enable Recording Module**

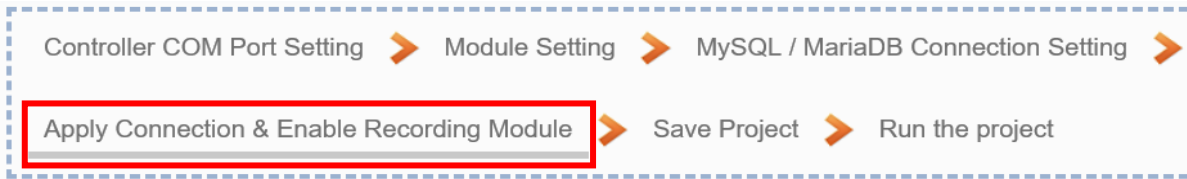


Click the next step, and enter the **Step 4 [Apply Connection & Enable Recording Module]** UI setting. This step is to enable the Modbus RTU module and connection.

We select the “Modbus RTU /MySQL(MariaDB)” of “Data Log” at the beginning, so this step will auto enter the [**Logger Setting > MySQL/MariaDB > RTU Module (Master)**] setting page. The “Step Box” will prevent the user from selecting the wrong platform.

Here **select** and **apply** the Database name (Ex: RemoteDB), and **enable** the M-7026.

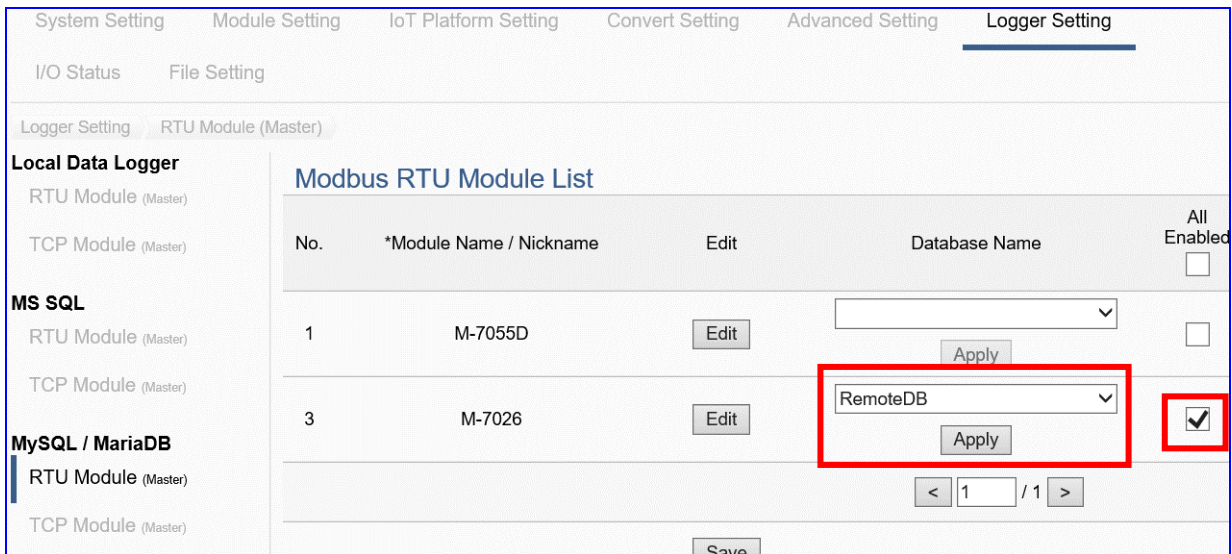


Logger Setting > MySQL/MariaDB > RTU Module (Master)	
No.	The module number in the module list (Not editable here)
*Module Name / Nickname	The module name set in the module list (Not editable here)
Edit	If user wants to enable some I/O channels for data logger, click [Edit] of that module to enter the “Content Setting”. It is normal to set all channels as enabled, and the function will not affect the unconnected channels.
Database Name	Select and apply the recording remote database name.
All Enabled	Check [All Enabled] box to enable all modules in list for data logger. Default: Uncheck. Check the “box” of each module can enable just that module for data logger.
	The page number of the module list: Current page / Total pages. Click < or > to go to the previous or next page.
Save	Click to save the settings of this page.

Classification	UA-Series English Function Wizard FAQ-dbl-05						
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	13 / 17


● **Step 5. Save Project**

The setting of this example is finished now. Click the next step [**Save Project**], the Step Box will show an animation as below picture, that means the project is saving. When the animation vanished, the project is saved completely.

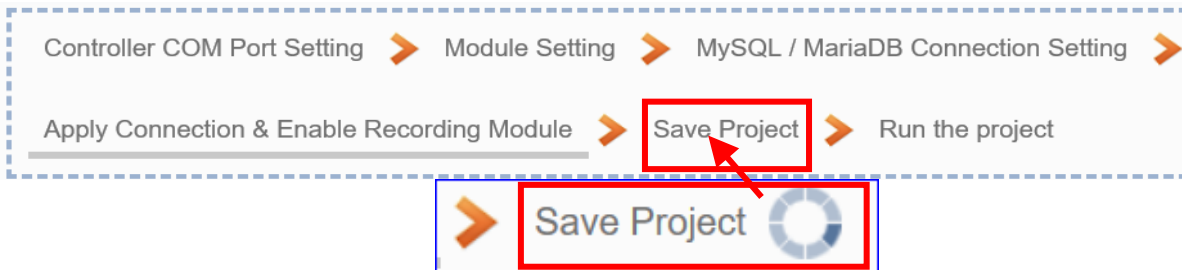

● **Step 6. Run the Project**

The project, after saving, needs to be executed. Click the next step [**Run the Project**]. This step can also be via the [**System Setting > Controller Service Setting > Run Project**] to Stop and Run the project.

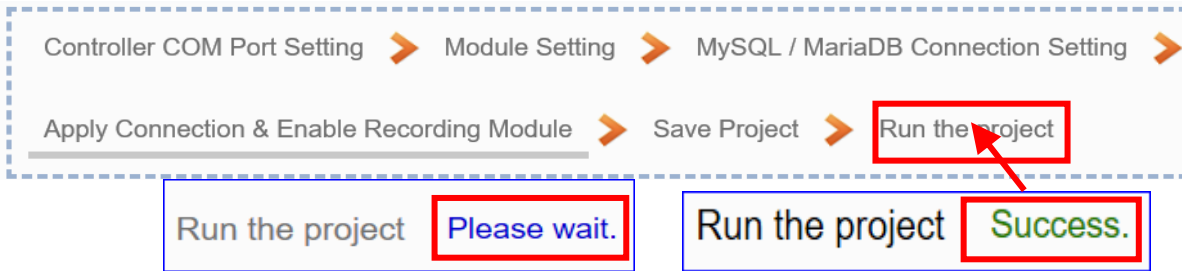

When the words “**Please wait**” disappears, the new words “**Success**” appears, that means the UA controller is running new project successfully. Then the Step Box will disappear automatically now, and back to the first screen view of the Web UI.

The new project now completes the setting, uploading and running in the UA controller and can process the new project communication. Users can see the I/O status from the menu [**I/O Status**]. For more about the Web UI settings, please refer to the UA Manual CH4 and CH5.

I/O Status
File Setting

Modbus RTU Module (Master)

No.	Name	Serial Port
3	M-7026	ttyO2
1	M-7055D	ttyO5

< 1 / 1 >

Modbus TCP Module (Master)

No.	Name	LAN
1	DL-302	LAN

< 1 / 1 >

Related Settings

Number of variables	<input type="text" value="10"/>	(Updated 10 points per second)
Display Update Time (ms)	<input type="text" value="1000"/>	

I/O Status

Variable Name	Data Type	Value	Description	Status
<input type="text" value="CO2"/>	Short	<input type="text" value="824"/>	<input type="text" value="room1"/>	Good
<input type="text" value="Relative_humidity"/>	Short	<input type="text" value="6798"/>	<input type="text"/>	Good
<input type="text" value="Temperature_Celsius"/>	Short	<input type="text" value="2099"/>	<input type="text"/>	Good
<input type="text" value="Temperature_Fahrer"/>	Short	<input type="text" value="6978"/>	<input type="text"/>	Good

Classification	UA-Series English Function Wizard FAQ-dbl-05							
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	14 / 17	

● **MySQL/MariaDB Remote Database Example Descriptions:**

Each tag data and status are recorded in each separate row, **the row is added down for each interval,** and the tag data is recorded in time sequence.

For database operation, please refer to **FAQ-002 (MySQL)** of the [UA series FAQ list](#):

[FAQ-002_How to save the UA collected data into SQL and then show trend chart in InduSoft? \(Take MySQL Installer 5.7.31 as an example\)](#)

The connection screen view of the **MySQL Remote Database**.

1. MySQL database screen view: Date/Time column separated (reference)

The screenshot shows a MySQL database interface with a query result grid. The query executed is `SELECT * FROM icpdas.module_all_date_time;`. The result grid displays the following data:

Date	Time	Name	Value	Status
2020/10/30	11:15:35	MRTU_No.1_tM-AD4P2C2_AO.Vin0	146	GOOD
2020/10/30	11:15:35	MRTU_No.1_tM-AD4P2C2_AO.Vin1	48	GOOD
2020/10/30	11:15:35	MRTU_No.2_DL-302_AO.CO2	650	GOOD
2020/10/30	11:15:35	MRTU_No.2_DL-302_AO.RH	6170	GOOD
2020/10/30	11:15:35	MRTU_No.2_DL-302_AO.TC	2622	GOOD
2020/10/30	11:15:35	MRTU_No.2_DL-302_AO.TF	7919	GOOD
2020/10/30	11:15:35	MRTU_No.2_DL-302_AO.DC	1828	GOOD
2020/10/30	11:15:35	MRTU_No.2_DL-302_AO.DF	6490	GOOD
2020/10/30	11:15:40	MRTU_No.1_tM-AD4P2C2_AO.Vin0	146	GOOD
2020/10/30	11:15:40	MRTU_No.1_tM-AD4P2C2_AO.Vin1	42	GOOD
2020/10/30	11:15:40	MRTU_No.2_DL-302_AO.CO2	650	GOOD
2020/10/30	11:15:40	MRTU_No.2_DL-302_AO.RH	6163	GOOD
2020/10/30	11:15:40	MRTU_No.2_DL-302_AO.TC	2621	GOOD
2020/10/30	11:15:40	MRTU_No.2_DL-302_AO.TF	7917	GOOD
2020/10/30	11:15:40	MRTU_No.2_DL-302_AO.DC	1825	GOOD
2020/10/30	11:15:40	MRTU_No.2_DL-302_AO.DF	6485	GOOD
2020/10/30	11:15:45	MRTU_No.1_tM-AD4P2C2_AO.Vin0	146	GOOD
2020/10/30	11:15:45	MRTU_No.1_tM-AD4P2C2_AO.Vin1	47	GOOD

Classification	UA-Series English Function Wizard FAQ-dbl-05						
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	15 / 17

2. MySQL database screen view: Date/Time column combined (reference)

The screenshot shows the MySQL Workbench interface. The left sidebar displays the 'SCHEMAS' tree with the 'icpdas' database selected. The main window shows a query: `SELECT * FROM icpdas.module_all_datetime;` The 'Result Grid' displays the following data:

DateTime	Name	Value	Status
2020-10-30 11:12:19	MRTU_No.1_#M-AD4P2C2_AO.Vin0	146	GOOD
2020-10-30 11:12:19	MRTU_No.1_#M-AD4P2C2_AO.Vin1	54	GOOD
2020-10-30 11:12:19	MRTU_No.2_DL-302_AO.CO2	636	GOOD
2020-10-30 11:12:19	MRTU_No.2_DL-302_AO.RH	6194	GOOD
2020-10-30 11:12:19	MRTU_No.2_DL-302_AO.TC	2616	GOOD
2020-10-30 11:12:19	MRTU_No.2_DL-302_AO.TF	7908	GOOD
2020-10-30 11:12:19	MRTU_No.2_DL-302_AO.DC	1829	GOOD
2020-10-30 11:12:19	MRTU_No.2_DL-302_AO.DF	6492	GOOD
2020-10-30 11:12:24	MRTU_No.1_#M-AD4P2C2_AO.Vin0	146	GOOD
2020-10-30 11:12:24	MRTU_No.1_#M-AD4P2C2_AO.Vin1	55	GOOD
2020-10-30 11:12:24	MRTU_No.2_DL-302_AO.CO2	636	GOOD
2020-10-30 11:12:24	MRTU_No.2_DL-302_AO.RH	6190	GOOD
2020-10-30 11:12:24	MRTU_No.2_DL-302_AO.TC	2616	GOOD
2020-10-30 11:12:24	MRTU_No.2_DL-302_AO.TF	7908	GOOD
2020-10-30 11:12:24	MRTU_No.2_DL-302_AO.DC	1827	GOOD
2020-10-30 11:12:24	MRTU_No.2_DL-302_AO.DF	6488	GOOD
2020-10-30 11:12:29	MRTU_No.1_#M-AD4P2C2_AO.Vin0	146	GOOD
2020-10-30 11:12:29	MRTU_No.1_#M-AD4P2C2_AO.Vin1	52	GOOD

Classification	UA-Series English Function Wizard FAQ-dbl-05						
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	16 / 17

The connection screen view of the **MariaDB Remote Database**.

1. MariaDB database screen view: Date/Time column separated (reference)

The screenshot shows the phpMyAdmin interface for a MariaDB 10 database. The selected database is 'ICPDAS' and the table is 'Module_All_Date_Time'. The SQL query displayed is 'SELECT * FROM `Module_All_Date_Time`'. The table view shows 25 rows of data with columns: Date, Time, Name, Value, and Status. Each row includes interactive icons for edit, copy, and delete.

	Date	Time	Name	Value	Status
<input type="checkbox"/>	2020/10/30	12:14:44	MRTU_No.1_tM-AD4P2C2_AO.Vin0	146	GOOD
<input type="checkbox"/>	2020/10/30	12:14:44	MRTU_No.1_tM-AD4P2C2_AO.Vin1	59	GOOD
<input type="checkbox"/>	2020/10/30	12:14:44	MRTU_No.2_DL-302_AO.CO2	637	GOOD
<input type="checkbox"/>	2020/10/30	12:14:44	MRTU_No.2_DL-302_AO.DC	1822	GOOD
<input type="checkbox"/>	2020/10/30	12:14:44	MRTU_No.2_DL-302_AO.DF	6479	GOOD
<input type="checkbox"/>	2020/10/30	12:14:44	MRTU_No.2_DL-302_AO.RH	6099	GOOD
<input type="checkbox"/>	2020/10/30	12:14:44	MRTU_No.2_DL-302_AO.TC	2635	GOOD
<input type="checkbox"/>	2020/10/30	12:14:44	MRTU_No.2_DL-302_AO.TF	7943	GOOD
<input type="checkbox"/>	2020/10/30	12:14:49	MRTU_No.1_tM-AD4P2C2_AO.Vin0	146	GOOD
<input type="checkbox"/>	2020/10/30	12:14:49	MRTU_No.1_tM-AD4P2C2_AO.Vin1	63	GOOD
<input type="checkbox"/>	2020/10/30	12:14:49	MRTU_No.2_DL-302_AO.CO2	636	GOOD
<input type="checkbox"/>	2020/10/30	12:14:49	MRTU_No.2_DL-302_AO.DC	1819	GOOD
<input type="checkbox"/>	2020/10/30	12:14:49	MRTU_No.2_DL-302_AO.DF	6474	GOOD
<input type="checkbox"/>	2020/10/30	12:14:49	MRTU_No.2_DL-302_AO.RH	6093	GOOD
<input type="checkbox"/>	2020/10/30	12:14:49	MRTU_No.2_DL-302_AO.TC	2634	GOOD
<input type="checkbox"/>	2020/10/30	12:14:49	MRTU_No.2_DL-302_AO.TF	7941	GOOD
<input type="checkbox"/>	2020/10/30	12:14:54	MRTU_No.1_tM-AD4P2C2_AO.Vin0	146	GOOD
<input type="checkbox"/>	2020/10/30	12:14:54	MRTU_No.1_tM-AD4P2C2_AO.Vin1	64	GOOD
<input type="checkbox"/>	2020/10/30	12:14:54	MRTU_No.2_DL-302_AO.CO2	636	GOOD
<input type="checkbox"/>	2020/10/30	12:14:54	MRTU_No.2_DL-302_AO.DC	1820	GOOD
<input type="checkbox"/>	2020/10/30	12:14:54	MRTU_No.2_DL-302_AO.DF	6476	GOOD
<input type="checkbox"/>	2020/10/30	12:14:54	MRTU_No.2_DL-302_AO.RH	6092	GOOD
<input type="checkbox"/>	2020/10/30	12:14:54	MRTU_No.2_DL-302_AO.TC	2635	GOOD
<input type="checkbox"/>	2020/10/30	12:14:54	MRTU_No.2_DL-302_AO.TF	7943	GOOD

Classification	UA-Series English Function Wizard FAQ-dbl-05						
Author	Eva Li	Version	1.0.0	Date	2021, 04	Page	17 / 17

2. MariaDB database screen view: Date/Time column combined (reference)

The screenshot shows the phpMyAdmin interface for a MariaDB database. The current database is 'ICPDAS' and the selected table is 'Module_All_DateTime'. The SQL query displayed is 'SELECT * FROM `Module_All_DateTime`'. The table view shows 328 records with the following columns: Date, Time, Name, Value, and Status. The records are sorted by Date and Time.

Date	Time	Name	Value	Status
2020-10-30	12:22:17	MRTU_No.1_tM-AD4P2C2_AO.Vin0	146	GOOD
2020-10-30	12:22:17	MRTU_No.1_tM-AD4P2C2_AO.Vin1	61	GOOD
2020-10-30	12:22:17	MRTU_No.2_DL-302_AO.CO2	640	GOOD
2020-10-30	12:22:17	MRTU_No.2_DL-302_AO.DC	1812	GOOD
2020-10-30	12:22:17	MRTU_No.2_DL-302_AO.DF	6461	GOOD
2020-10-30	12:22:17	MRTU_No.2_DL-302_AO.RH	6036	GOOD
2020-10-30	12:22:17	MRTU_No.2_DL-302_AO.TC	2642	GOOD
2020-10-30	12:22:17	MRTU_No.2_DL-302_AO.TF	7955	GOOD
2020-10-30	12:22:22	MRTU_No.1_tM-AD4P2C2_AO.Vin0	146	GOOD
2020-10-30	12:22:22	MRTU_No.1_tM-AD4P2C2_AO.Vin1	62	GOOD
2020-10-30	12:22:22	MRTU_No.2_DL-302_AO.CO2	640	GOOD
2020-10-30	12:22:22	MRTU_No.2_DL-302_AO.DC	1812	GOOD
2020-10-30	12:22:22	MRTU_No.2_DL-302_AO.DF	6461	GOOD
2020-10-30	12:22:22	MRTU_No.2_DL-302_AO.RH	6038	GOOD
2020-10-30	12:22:22	MRTU_No.2_DL-302_AO.TC	2642	GOOD
2020-10-30	12:22:22	MRTU_No.2_DL-302_AO.TF	7955	GOOD
2020-10-30	12:22:27	MRTU_No.1_tM-AD4P2C2_AO.Vin0	146	GOOD
2020-10-30	12:22:27	MRTU_No.1_tM-AD4P2C2_AO.Vin1	59	GOOD
2020-10-30	12:22:27	MRTU_No.2_DL-302_AO.CO2	640	GOOD
2020-10-30	12:22:27	MRTU_No.2_DL-302_AO.DC	1811	GOOD
2020-10-30	12:22:27	MRTU_No.2_DL-302_AO.DF	6459	GOOD
2020-10-30	12:22:27	MRTU_No.2_DL-302_AO.RH	6038	GOOD
2020-10-30	12:22:27	MRTU_No.2_DL-302_AO.TC	2641	GOOD
2020-10-30	12:22:27	MRTU_No.2_DL-302_AO.TF	7953	GOOD