



TM

M2M-711D

User Manual
Ver 3.0.0



<http://www.icpdas.com>

Warranty

All products manufactured by ICP DAS are under warranty regarding defective materials for a period of one year from the date of delivery to the original purchaser.

Warning

ICP DAS assumes no liability for damages resulting from the use of this product. ICP DAS reserves the right to change this manual at any time without notice. The information furnished by ICP DAS is believed to be accurate and reliable. However, no responsibility is assumed by ICP DAS for its use, or for any infringements of patents or other right of third parties resulting from its use.

Copyright

Copy right 2011 by ICP DAS. All rights are reserved.

Trademark

The names used for identification only may be registered trademarks of their respective companies.

List of Revision

Date	Author	Version	Description
2011/05/01	Bird	1.0.0	V1.0.0
2011/12/21	Bird	2.0.0	V2.0.0
2025/10/08	Jay	3.0.0	V3.0.0 Replace Wifi module

Table of Contents


1. Introduction.....	5
1.1 Features.....	7
1.2 Hardware Specifications.....	8
1.3 Statement of connection mode.....	9
2. Hardware.....	10
2.1 Appearance.....	10
2.2 Wiring.....	11
2.2.1 RS-232 connection.....	11
2.2.2 RS-485 connection.....	12
2.2.3 Ethernet mode connection.....	12
2.2.4 AP mode connection.....	13
2.3 Init Switch and Init Pin.....	14
2.4 5-Digit 7 Segment LED Display.....	15
3. Configuration and Operation with Web Browser.....	23
3.1 Connection Setting.....	23
3.2 Web Configuration – Function Menu.....	28
3.3 Sub Web Page.....	30
3.3.1 Login.....	30
3.3.2 User Account.....	30
3.3.3 Standard Config.....	31
3.3.4 Wireless Config.....	35
3.3.5 DDNS Config.....	37
3.3.6 Com Port Config (Pair-Connection mode).....	42
3.3.7 Operation Mode.....	43
3.3.8 Information.....	44
4. VxComm Applications.....	45
4.1 VxServer Introduction.....	45
4.2 VxServer Installation.....	45
4.3 VxComm Introduction.....	46
4.4 VxComm Driver Installation.....	46
4.5 VxServer Working.....	47
4.6 VxServer Mode Communication Test.....	50

5. Firmware update.....	52
6. Troubleshooting.....	57
7. FAQ.....	58
8. Dimensions.....	62
9. Frame Ground.....	64


1. Introduction

The M2M-711D module is specially designed for the remote maintenance solution. It can be used to maintain the remote machines with other module(ex : M2M-710D 、 M2M-711D 、 M-4132...etc) through Ethernet. Servicemen can maintain remote machines as real as he has been on the spot. That can not only reduce the business travel cost, but also save the time of waiting for maintaining equipments. The remote maintenance solution redefines maintenance service that we pass understood, and the equipment manufacturer may solve the problem to grasp the customer demand and the opportunity rapidly.

The M2M-711D built-in Wi-Fi(802.11b/g) function can be applied to the already Wi-Fi system. It can connect to the remote equipment by Wi-Fi AP to reduce the wire cost.

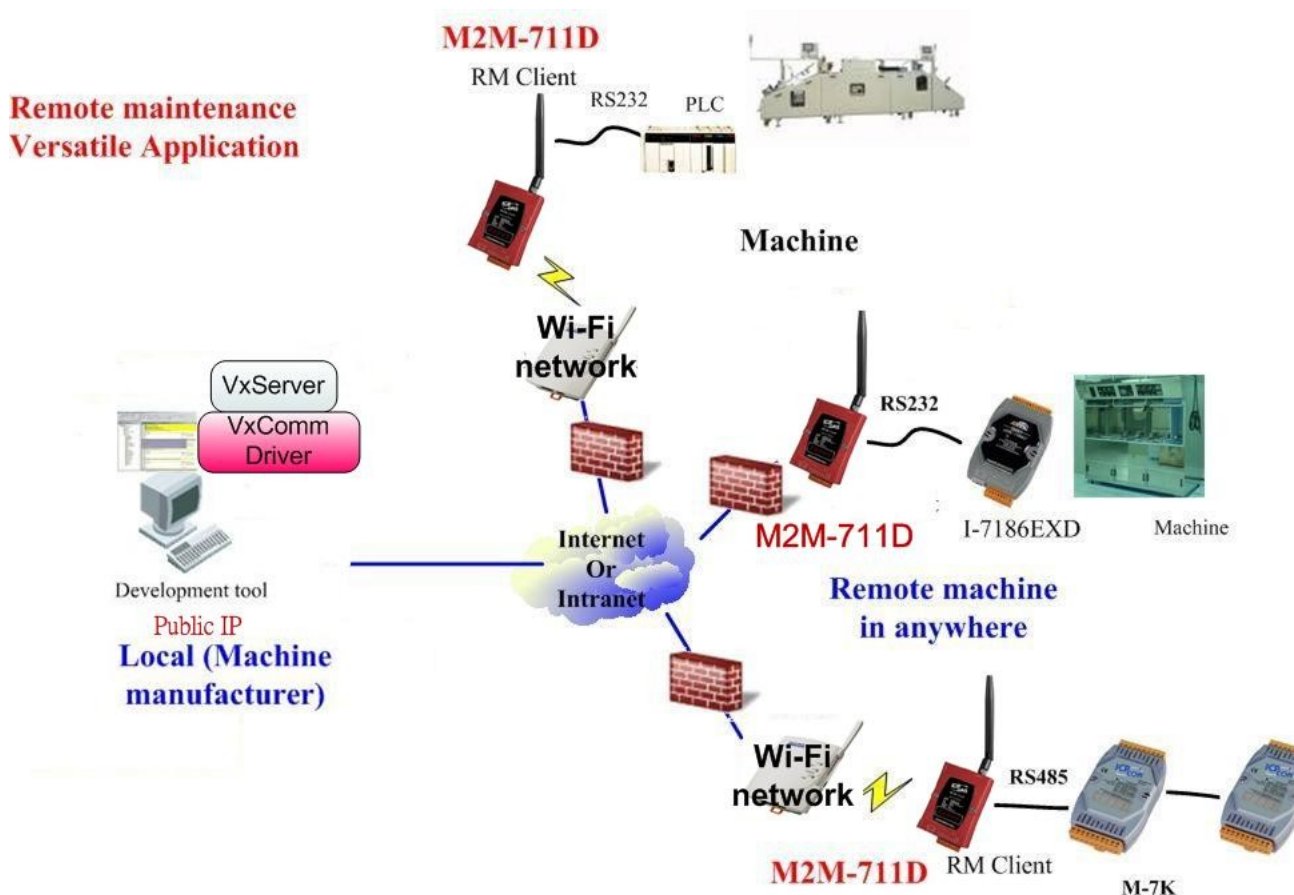

In addition, the M2M-711D has a Powerful Function, Pair Connection, to upgrade the original serial application to network application

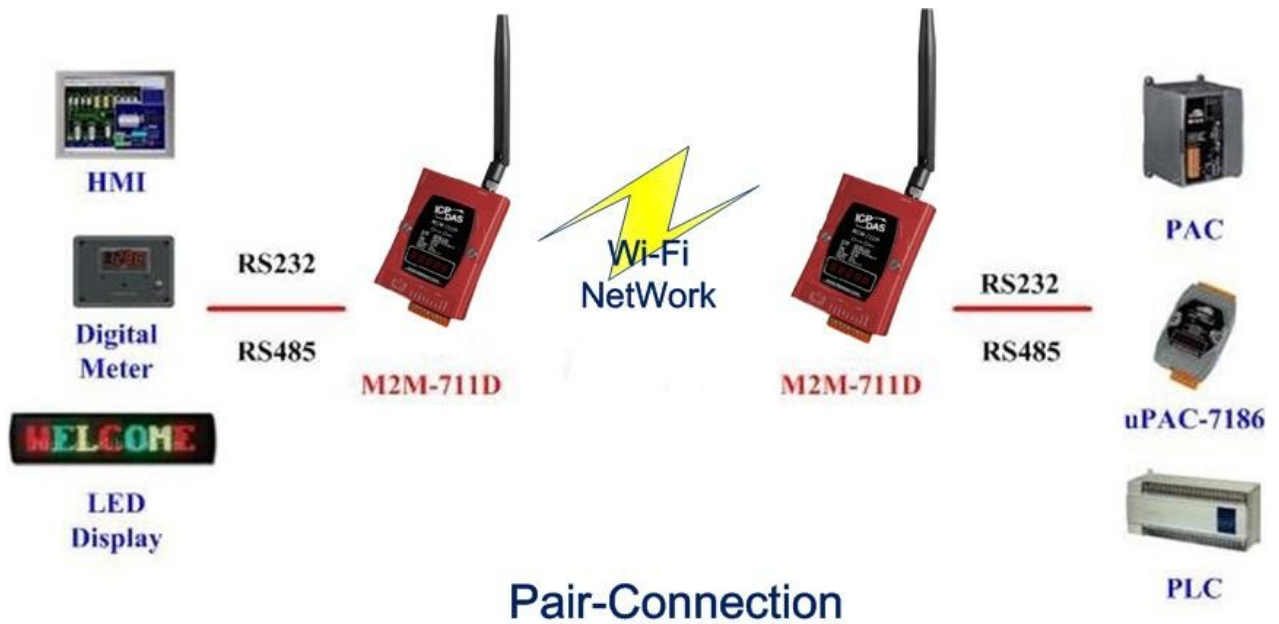

1.1 Features

In the communication architecture of PC and M2M modules, it needs include one PC and multi M2M modules. The PC must have public IP and set the firewall suitably to make sure the normal communication. In the stable network communication, the M2M series can provide remote maintenance for the remote equipments easily. The features of the M2M-711D are as follows:

- ❖ Quick start
- ❖ Support VxServer software
- ❖ Built-in self-tuner ASIC chip for RS-485 port
- ❖ Provide pair connection (RS-232,RS-485) on network
- ❖ Support Server and Client communication mode
- ❖ Be applied with other M2M products (M2M-420-A, M2M-720-A, M2M-710D...)
- ❖ Support RS-232 or RS-485 serial communication ports
- ❖ Supply static IP/DHCP
- ❖ Built-in self-tuner ASIC chip for RS-485 port
- ❖ Web-based administration
- ❖ Built-in MiniOS7 OS to keep off the computer virus
- ❖ Ethernet Protocol: TCP, UDP, IP, ICMP, ARP, RARP
- ❖ Supports IEEE 802.11 b/g for Wi-Fi mode
- ❖ Supports WEP-64,WEP-128, WPA-TKIP and WPA2-AES encryption for AP mode (Firmware version is v2.X)
- ❖ Supports WPA\WPA2\WPA3 encryption for AP mode (Firmware version is v3.X)
- ❖ Provide dynamic DNS function
- ❖ 5-Digit 7 Segment LED Display
- ❖ EMI, RoHS compliance

1.2 Hardware Specifications

CPU	80186, 80 MHz
SRAM	512 KB
Flash Memory	Flash ROM: 512 KB ; Erase unit is one sector (64 KB) ; 100,000 erase/write cycles
EEPROM	16 KB; Data retention: 40 years; 1,000,000 erase/write cycles
Communication Interface	
COM1	RS-232(RxD, TxD, RTS, CTS, GND); None-isolation
COM2	RS-485(DATA+, DATA-); None-isolation
Ethernet Port	10/100 Base-TX
COM Port Formats	
Data Bit	7, 8: for COM1 and COM2
Parity	None, Even, Odd
Stop Bit	1,2: for COM1, COM2
Baud Rate	1200/2400/4800/9600/19200/38400/57600/115200 bps
LED Display	
5-Digit 7 Segment	Yes
System LED Indicator	Yes
Wi-Fi LED Indicator	Yes
Mechanism	
Flammability	Fire Retardant Materials (UL94-V0 Level)
Dimension	72 mm x 33 mm x 123 mm (W x L x H) Detail
Operating Environment	
Operating Temperature	-25 ~ +75 °C
Storage Temperature	-40 ~ +80 °C
Power	
Protection	Power Reverse Polarity Protection
Required Supply Voltage	Unregulated +10 V _{DC} ~ +30 V _{DC}
Power Consumption	3.5 W for M2M-711D
Wireless Module	
RF channels	1~13; AP mode support auto control channel.
Receive sensitivity	-87 dBm(IEEE 802.11b) / -72 dBm (IEEE 802.11g)
Transmission range (LOS)	100M
Transmit Power	12 dBm(IEEE 802.11b) / 14 dBm(IEEE 802.11g)
Antenna	2.4GHz - 5dBi Omni-Directional antenna

1.3 Statement of connection mode

M2M-711D has two kinds of communication mode. They are VxServer and Pair-Connection and each of them has two kinds of transmission type, Ethernet, and Wi-Fi modes, moreover, each type of them has three communication roles.

Communication Mode:

- **VxServer Mode:**

In this mode, users must install VxServer and VxComm Driver in the PC to use serial communication.

- **Pair-Connection Mode:**

This mode requires two M2M modules cooperate with each other, one is Pair-Connection Server the other is Pair-Connection Client.


Transmission Type:

- **Ethernet:** This mode use RJ-45 Ethernet cable to connect to the Internet and transmit data with others M2M devices.

- **AP:** This mode use Wi-Fi AP to connect to the Internet and transmit data

2. Hardware

2.1 Appearance

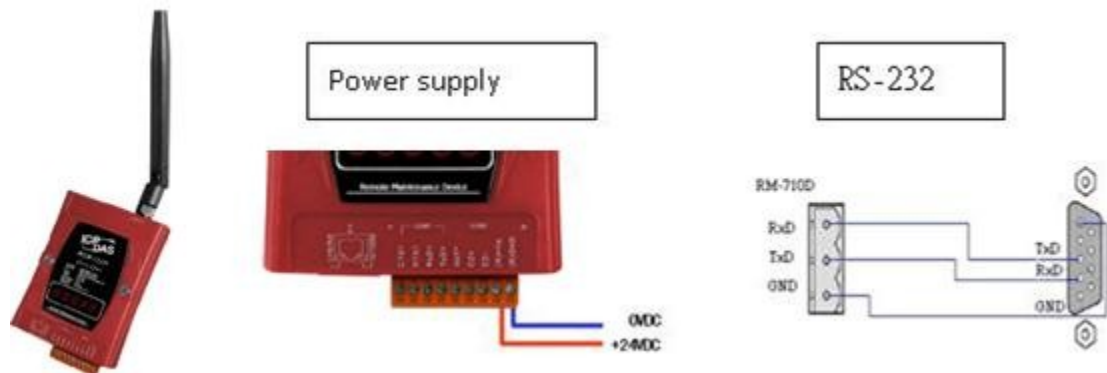


M2M-711D pin assignment

Pin	Name	Description
1	CTS1	Clear to Send
2	RTS1	Request to Send
3	RxD1	Receive Data
4	TxD1	Transmit Data
5	INIT	Init Pin
6	DATA+	Data+ of RS-485
7	DATA-	Data- of RS-485
8	Vs	Vs of Power Supply
9	GND	GND of Power Supply

8-PIN and RJ-45 socket pin assignment

Pin	Name	Description
1	TX+	TX+ output
2	TX-	TX- output
3	RX+	RX+ input
4	-	N/A
5	-	N/A
6	RX-	RX- input
7	-	N/A
8	-	N/A



2.2 Wiring


The connection interfaces of the M2M-711D include RS-232, RS-485 and Ethernet. The connection wiring is illustrated in section 2.2.1, 2.2.2 and 2.2.3.

(Warning: M2M-711D can't be connected to the RS232 and RS485 at the same time)


2.2.1 RS-232 connection

There are two types of RS-232 ports, one is DTE (Data Terminal Equipment, like PC, Serial Printers, PLC, and Video Cameras), the other is DCE (Data Circuit-Terminating Equipment, like modem).

The M2M-711D module is a DTE and users can use “3-wire” RS-232 or “5-wire” RS-232 to connect. When connecting the M2M-711D to a DCE device, the user just needs to match the signal names. When connecting the M2M-711D to a DTE device, the user needs to use a crossover cable (TX crosses to RX, GND to GND), as shown below.

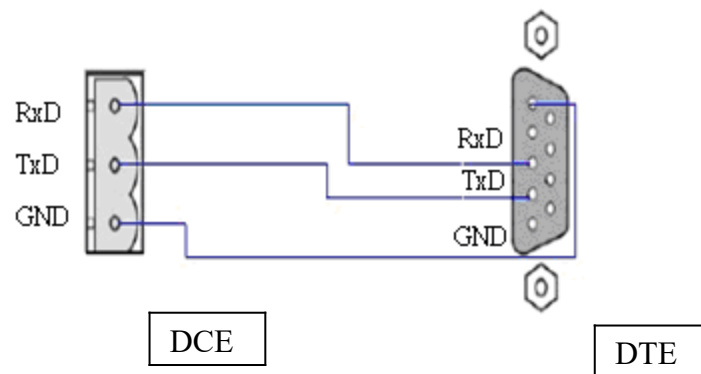


❖ RS-232 Three-wire connection

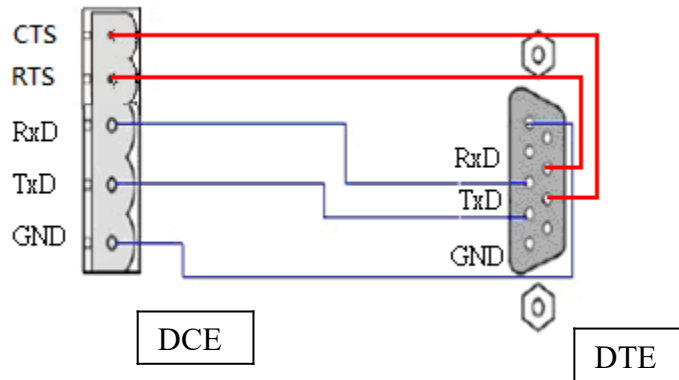

❖ RS-232 Five-wire connection

2.2.2 RS-485 connection

The RS-485 wiring diagram as shown below.

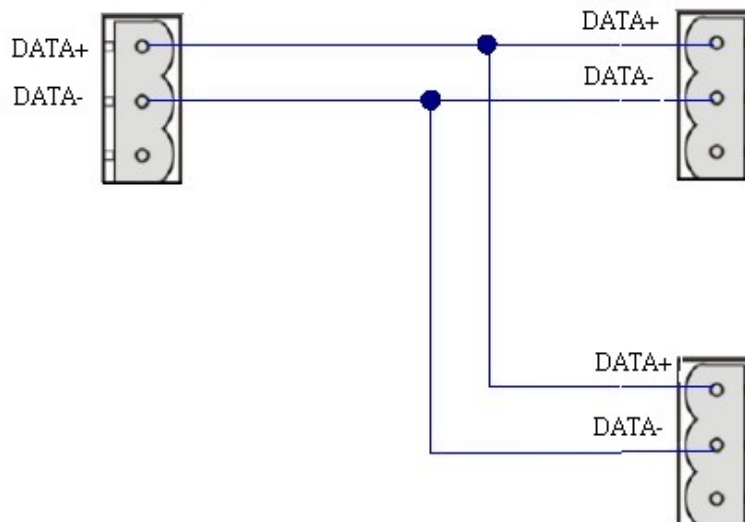

❖ RS-485 connection

2.2.3 Ethernet mode connection

In the Ethernet mode connection way, users must adjust the firewall before application running to make sure clients can connect to the server. The default value of VxServer port is 11000. Users must also pay attention to two things, the firewall must open this port and the PC must have public IP, to ensure the normal connection.

2.2.4 AP mode connection


The M2M-711D must connect with Wi-Fi AP in this mode, and the Wi-Fi AP must be compatible with IEEE 802.11b / g wireless network protocol.



2.3 Init Switch and Init Pin

There are an Init switch and Init Pin inside M2M-711D to make it into initial mode. If Init Pin connects to GND or Init Switch is selected for init mode, system will clear all EEPROM information. The M2M-711D will restore originally setting.

When the init pin is removed, the M2M-711D must to reset power to run in the normal mode.

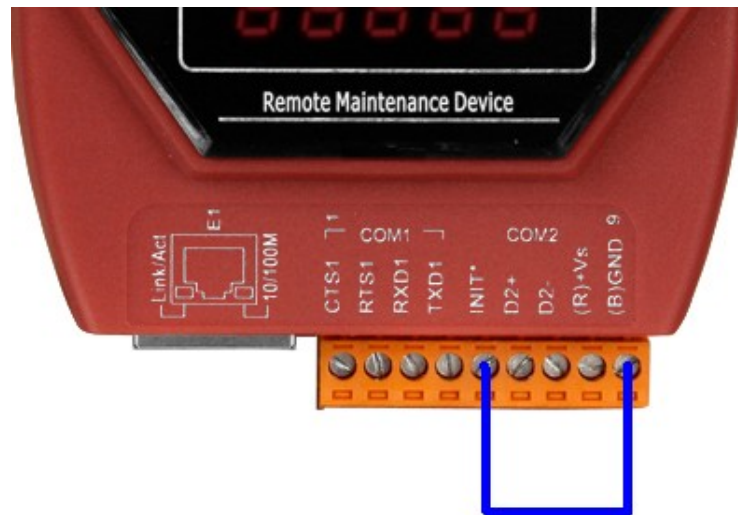

▲Recovery to the factory configuration by Init pin








▲Recovery to the factory configuration by Init switch

2.4 5-Digit 7 Segment LED Display

The M2M-711D is built-in 5-Digit 7 segment LED Display. User can get the system information from the starting process. The messages are shown as VxServer, Pair-Connection Server and Pair-Connection Client types. Each type is shown as Ethernet, AP modes.




5-Digit 7 Segment LED Display of VxServer Mode

The following message will be shown in Boot Display:

Display Process	Information
	Initial setting
	Ethernet Mode
	AP Mode
	Shows the local IP or DHCP sequentially
	Shows the VxServer IP sequentially
	Shows the connection port
	Shows the setting of Com port C#:1/2 represents COM1/COM2 Baud: 300~115200. 300, 600, 1200, 2400, 4800, 9600, 19200, 38400, 57600, 115200 ° Data: 7 or 8. Parity: 0(None), 1(Even) or 2(Odd) ° Stop: 1 or 2
	In AP mode, it is shown the IP message set by web server of M2M-711D.


Login Server:

When the Startup is successful, will begin the VxServer connection, and login the VxServer, the following is the LED connection display.

Server messages	Information
	If the VxServer isn't connected it will be shown with a flicker.
	In the AP mode, there is no Server's IP signal for Ping. Please check the setting of Server IP and Wireless Config.
	Shows the wireless signal strength in Wi-Fi AP mode. It is not connected by the client module. 0 : No signal 1 : Weak signal 2 : Middling signal 3 : Good signal
	It can't connect with AP in the AP mode, please check the setting of Wireless Config.
	It's the light for the setting of Web in AP mode.

Serial communication:

It will enter the serial communication mode, when the server connects to the M2M-711D, and the display will show the Comport information repeatedly. If the connection fails, the system will restart in 50 seconds.


Serial messages	Information
	Example Com Port : 1(RS232) Date : 8 Parity : none Stop : 1
	Baud rate : 9600

Example:

The setting of VxServer AP mode:

Wi-Fi IP	192.168.1.118(DHCP)
VxServer IP	192.168.1.113
Set IP	192.168.1.200
VxServer Connected port	11000
Baud rate	115200
Com Port	1(RS232)
Date	7
Parity	Even
Stop bit	2

The shown messages would display sequentially as follows. The interval time between every message is 50 ms.

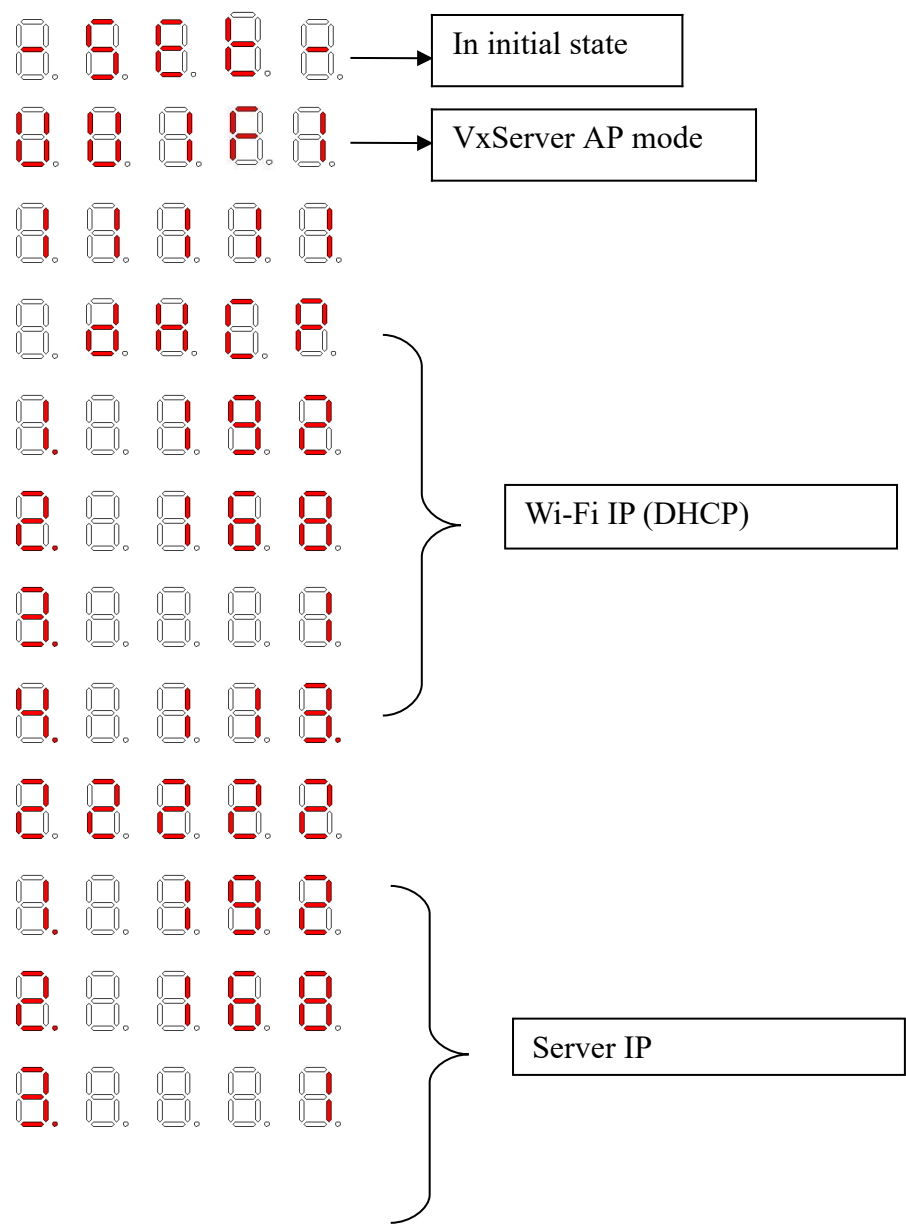

8. 8. 8. 8. 8.

8. 8. 8. 8. 8.

8. 8. 8. 8. 8.

VxServer Connected Port

8. 8. 8. 8. 8.

8. 8. 8. 8. 8.

Comport port setting

8. 8. 8. 8. 8.

8. 8. 8. 8. 8.

8. 8. 8. 8. 8.

8. 8. 8. 8. 8.

SET IP
(Web Server IP)

8. 8. 8. 8. 8.

8. 8. 8. 8. 8.

8. 8. 8. 8. 8.

8. 8. 8. 8. 8.

The M2M-711D doesn't connect to the AP.

8. 8. 8. 8. 8.

8. 8. 8. 8. 8.

As not connected by the client site, shows the AP
signal messages repeatedly.

8. 8. 8. 8. 8.





8. 8. 8. 8. 8.

As connecting with the client module, shows the com
port setting of client site repeatedly.



8. 8. 8. 8. 8.


7 Segment LED Display of Pair-Connection Server Mode

Boot Display:

Display Process	Information
	Initial setting
	Ethernet Pair-Connection Server Mode
	AP Pair-Connection Server Mode
	Shows the local IP or DHCP sequentially
	Monitor's port
	Shows the setting of Com port C#:1/2 represents COM1/COM2 Baud: 300~115200. 300, 600, 1200, 2400, 4800, 9600, 19200, 38400, 57600, 115200 ° Data: 7 or 8. Parity: 0(None), 1(Even) or 2(Odd) ° Stop: 1 or 2
	In Wi-Fi mode, it is shown the IP message set by web server of M2M-711D.

Monitor:

The Login Display of Pair-Connection Server	Information
	Monitoring
	The host name of the Pair-Connection Client is wrong. Please check the Client name of the Pair-Connection Server is the same as the Client's 'Host name'.
	In AP mode, When the Wi-Fi has not yet connected, it shows the Wi-Fi signal strength (0~3).

	0 : No signal 1 : Weak signal 2 : Middling signal 3 : Good signal
	The M2M-711D can't connect to the AP in AP mode, please check the setting of Wireless Config.
	It shows when users enter the web setting interface in the Ap mode.





Serial communication messages:

When the M2M-711D is chosen to communicate by the server, the LED display shows com port messages repeatedly.

Serial communication messages	Information
	Example Com Port : 1(RS232) Date : 8 Parity : none Stop bit : 1
	Baud rate : 9600

7 Segment LED Display of Pair-Connection Clint Mode




The following message will be shown in Boot Display:

Display Process	Information
	Initial setting
	Ethernet Client Mode
	Wi-Fi Client Mode
	Shows the local IP or DHCP sequentially
	Shows the Server sequentially.
	Shows the connecting port.
	Shows the setting of Com port. C#:1/2 represents COM1/COM2 Baud: 300~115200. 300, 600, 1200, 2400, 4800, 9600, 19200, 38400, 57600, 115200 ° Data: 7 or 8. Parity: 0(None), 1(Even) or 2(Odd) ° Stop: 1 or 2
	If user is in the Wi-Fi mode, it shows the IP set by web server.

Login Server:

When the Startup is successful, will begin the VxServer connection, and login the VxServer, the following is the LED connection display.

Server messages	Information
	Flickery: Connection failed. Stable: Connection successful.
	In the AP mode, there is no Server's IP signal for Ping. Please check the setting of Server IP and Wireless Config.


	Shows the wireless signal strength in AP mode. It is not connected by the client module. 0: No signal 1: Weak signal 2: Middling signal 3: Good signal
	It can't connect with AP in the AP mode, please check the setting of Wireless Config.
	It's the light for the setting of Web in AP mode.

3. Configuration and Operation with Web Browser

The M2M-711D module is built-in web server, the user can configure and operate the M2M-711D by web browser (ex: IE).

3.1 Connection Setting

Before you open the web browser to configure the module, it needs to connect the M2M-711D and your PC in the same sub network or same Ethernet Switch (as shown in figure 11) and set network settings (such as IP/Mask/Gateway) of the PC. The example of connection setting will be described below and Microsoft Windows XP Professional SP2 is used.

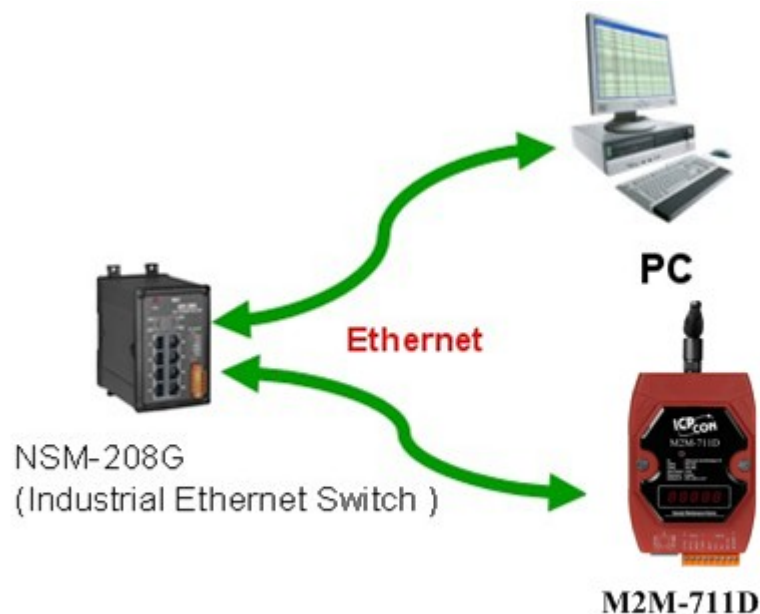


▲The connection architecture of PC and M2M-711D


Connection steps:

Step1: Open Network Connections


1. Click “start→Settings→Network Connections”

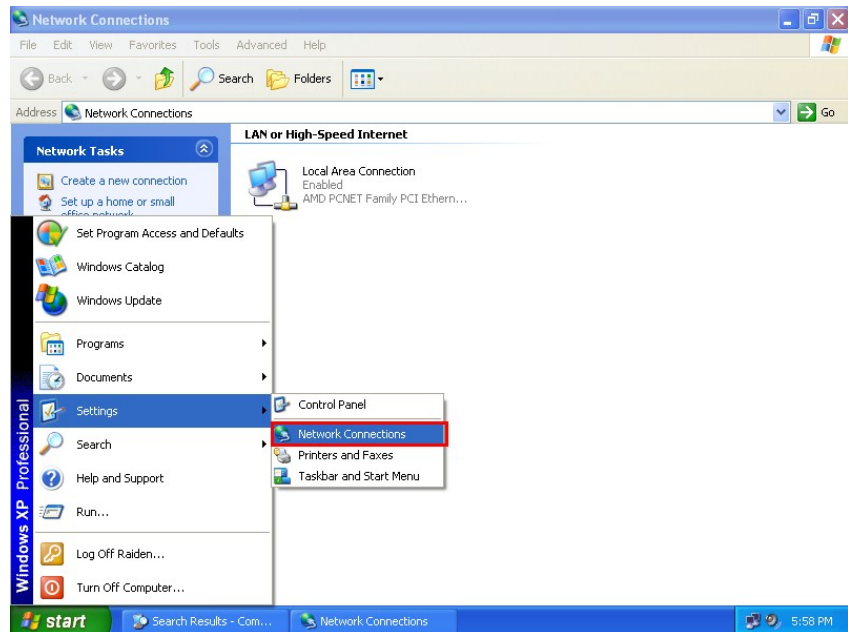


Click “Properties” button

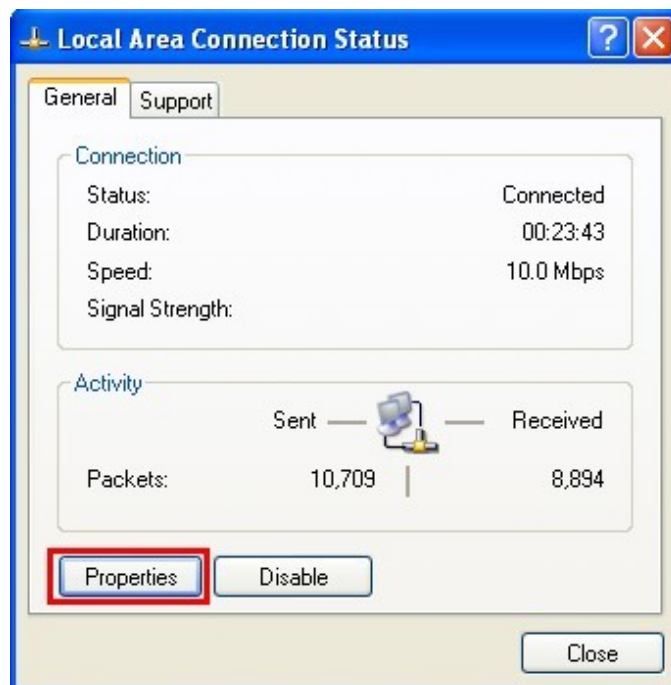

-
2. Click Internet Protocol(TCP/IP) and then click the contents

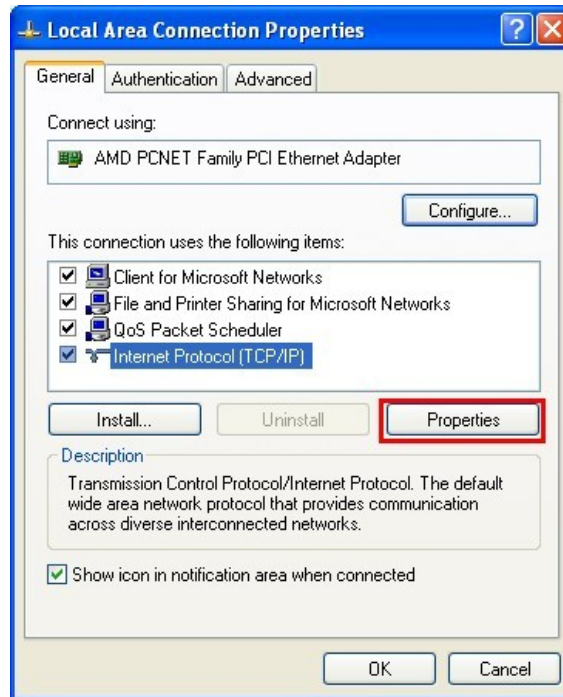

- Step2: “Internet Protocol Properties” and then click “OK” button.

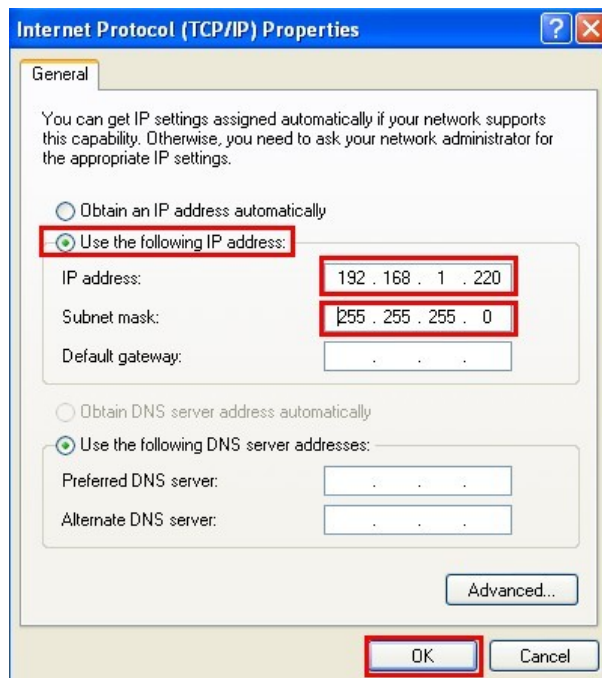


Step3: test connection


1. Click “start→Run...”



2. Key in “cmd” and then click “OK”

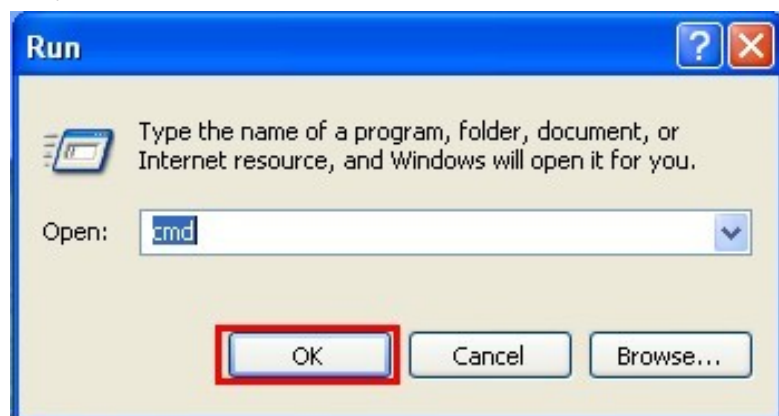

3. Key in “ping 192.168.1.217” and click “Enter”. If the response message shows “Request timed out” (as the following figure), it means the network settings between PC and the module are not correct. Please check the network is available and the settings are all correct.

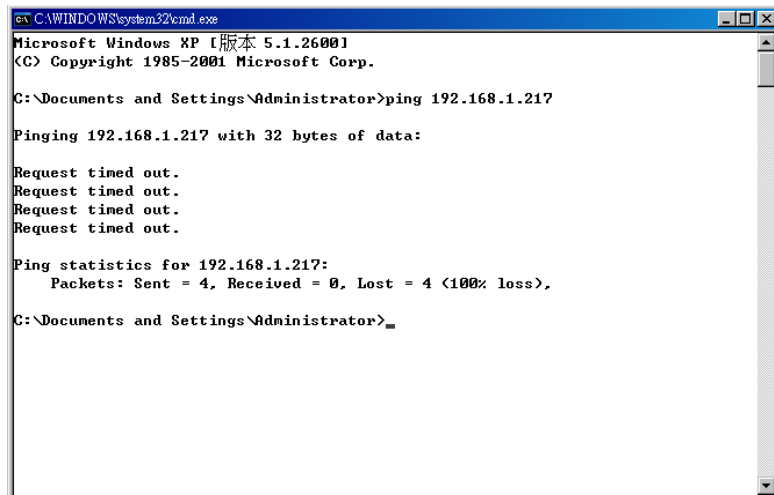

```
C:\WINDOWS\system32\cmd.exe
Microsoft Windows XP [版本 5.1.2600]
(C) Copyright 1985-2001 Microsoft Corp.

C:\Documents and Settings\Administrator>ping 192.168.1.217


Pinging 192.168.1.217 with 32 bytes of data:

Request timed out.
Request timed out.
Request timed out.
Request timed out.

Ping statistics for 192.168.1.217:
    Packets: Sent = 4, Received = 0, Lost = 4 (100% loss),

C:\Documents and Settings\Administrator>
```

If the network settings are correct, it will show
“Packets: Sent=4, Received=4, Lost=0”

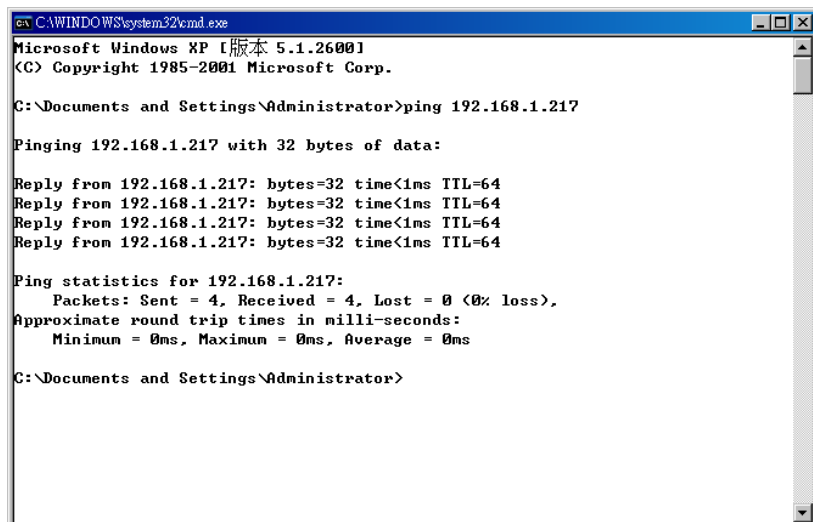

```
C:\WINDOWS\system32\cmd.exe
Microsoft Windows XP [版本 5.1.2600]
(C) Copyright 1985-2001 Microsoft Corp.

C:\Documents and Settings\Administrator>ping 192.168.1.217

Pinging 192.168.1.217 with 32 bytes of data:


Reply from 192.168.1.217: bytes=32 time<1ms TTL=64
Reply from 192.168.1.217: bytes=32 time<1ms TTL=64
Reply from 192.168.1.217: bytes=32 time<1ms TTL=64
Reply from 192.168.1.217: bytes=32 time<1ms TTL=64

Ping statistics for 192.168.1.217:
    Packets: Sent = 4, Received = 4, Lost = 0 (0% loss),
    Approximate round trip times in milli-seconds:
        Minimum = 0ms, Maximum = 0ms, Average = 0ms

C:\Documents and Settings\Administrator>
```

3.2 Web Configuration – Function Menu

Now the PC is set completely and working well with the M2M-711D. Please open web browser (ex: IE, Mozilla, etc) on PC and key in <http://192.168.1.217/main.htm> in the Address line and then press “Enter” key to link the M2M-711D, as shown below.

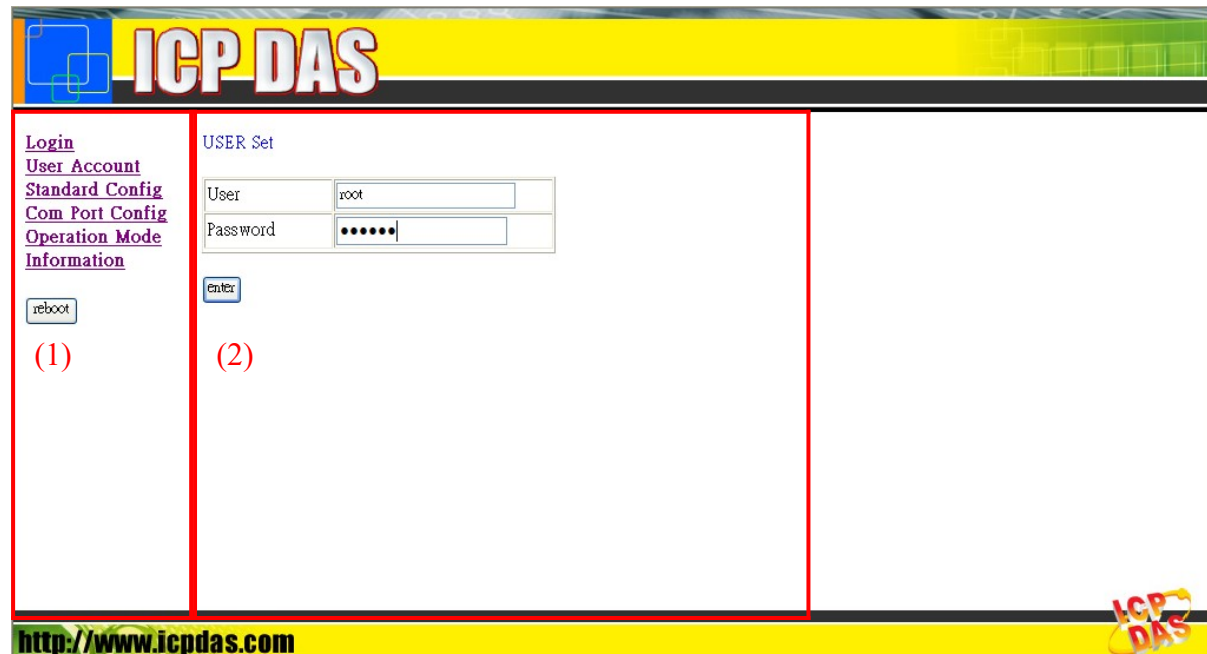

In the above figure, the left side is the function menu and the other side is the setup page in the first page. The contents of “VxServer mode, Pair-Connection Server mode” and “Pair-Connection Client mode” are different, the specification as shown below:

The web function menu of VxServer mode

- Login
- User Account
- Standard Config
- Wireless mode
- Operation Mode
- Information

Reboot

The web function menu of Pair-Connection Server mode

-
- Login
 - User Account
 - Standard Config
 - Wireless mode
 - DDNS Config
 - Operation Mode
 - Information

Reboot

The web function menu of Pair-Connection Client mode

- Login
- User Account
- Standard Config
- Wireless mode
- Com Port Config
- Operation Mode
- Information

Reboot

The “Reboot” button can provide the user to save these setting and restart the M2M-711D.

3.3 Sub Web Page

Note: As changing these settings, the M2M-711D need to reset to become effective.

3.3.1 Login

The user login interface: (Default setting – User: root, Password: icpdas)

USER Set

User	root
Password	•••••



3.3.2 User Account

After login to the web server, the user name and password can be edited in this page.

The screenshot shows the ICP-DAS web interface. At the top is a yellow banner with the "ICP-DAS" logo. Below the banner, on the left, is a navigation menu with links: [Login](#), [User Account](#), [Standard Config](#), [Com Port Config](#), [Operation Mode](#), and [Information](#). The "User Account" link is highlighted. In the center, there is a "USER Set" section with a form containing three rows: "User" with a text input field containing "root", "Password" with a password input field containing "•••••", and "CheckPassword" with a password input field containing "•••••". Below the form are two buttons: "reboot" and "Change". At the bottom of the page is a yellow footer bar containing the URL "http://www.icpdas.com" on the left and the "ICP-DAS" logo on the right.

3.3.3 Standard Config

The different operation modes have the different setting. The description is as follows.

Select Mode:

System	There are three operation modes in M2M-711D. VxServer mode: M2M-711D connect with PC directly. (The PC have to install VxServer software and VxComm Driver beforehand.) Pair-Connection Server mode: This mode can connect with the Pair-Connection Client of M2M device. Pair-Connection Client mode: This mode can connect with the Pair-Connection Server of M2M device.
--------	--

VxServer mode

Host Name	It can set the name of the module. User can use the clearer and simpler name to recognize.
Station ID	It can offer the identification to VxServer to recognize the different M2M devices, and the Station ID can't be repeated during multiple M2M devices.
Connect to Server by : IP / DNS	This item set the connection with M2M-711D and VxServer according to VxServer's IP or Domain Name °
Server IP	Set the VxServer's IP address.
Communication Port	Set the port number of VxServer. Default Value: 11000
Boot Protocol (Static IP /DHCP)	M2M-711D supports two kinds of IP modes; they are "Static IP" and "DHCP". Users can choose one of them to set the Ethernet IP address of M2M-711D.
Ethernet IP	Set the static IP of Ethernet. It is also the IP for the

(Web Server IP)	web server. Because when users are in the Wireless mode, they must through the IP to enter the setting interface of Web Server. We recommend users to use the Static IP to convenient the setting.
Netmask	When Boot Protocol is “Static IP”, the user can set subnet mask of M2M-711D in this setting.
Gateway	When Boot Protocol is “Static IP”, the user can set gateway of M2M-711D in this setting.
DNS Server	When Boot Protocol is “Static IP”, users can set Domain Name Service Server of M2M-711D in this setting.

Pair-Connection Server mode

Host Name	The module name. The maximum character length is 15.
Client Name	It can set the module name, and the Client Name must be the same as the Host name of Pair-Connection that will be connected. The maximum character length is 15.
Listen Port	Users can set the port number of the Pair-Connection server, and that must be the same with the Communication Port of Pair-Connection Client. Default Value: 11000.
Heart Bit	Set whether the module transmit the heartbeat in the Pair-Connection mode. We recommend users to set Enable.
Boot Protocol (Static IP /DHCP)	M2M-711D supports two kinds of IP modes; they are “Static IP” and “DHCP”. User can choose one of them to set the Ethernet IP address of M2M-711D.
Ethernet IP (Web Server IP)	Set the IP address of Ethernet. It is also the IP for the web server. Because when users are in the Wireless mode, they must through the IP to enter the setting interface of Web Server. We recommend users to use the Static IP to convenient the setting.

Netmask	When Boot Protocol is “Static IP”, the user can set subnet mask of M2M-711D in this setting.
Gateway	When Boot Protocol is “Static IP”, the user can set gateway of M2M-711D in this setting.
DNS Server	When Boot Protocol is “Static IP”, users can set Domain Name Service Server of M2M-711D in this setting.

Pair-Connection Client mode

Host Name	It can set the name of the module. User can use the clearer and simpler name to recognize. The name must be the same as the Client Name of Pair-Connection Server when the system is connecting with Pair-Connection Server. The maximum character length is 15.
Connect to Server by : IP / DNS	This item set the connection with Pair-Connection Server according to the IP of Pair-Connection Server or Domain Name .
Server Name	Users can set the Server Name of the server that the client wants to connect to. The maximum character length is 15.
Server IP	Users can set the IP address of the server that the client wants to connect to.
Communication Port	Set the port number of the server that will be linked by clients, and its default value is 11000.
Boot Protocol (Static IP /DHCP)	M2M-711D supports two kinds of IP modes; they are “Static IP” and “DHCP”. Users can choose one of them to set the Ethernet IP address of M2M-711D.
Ethernet IP (Web Server IP)	Set the IP address of Ethernet. It is also the IP for the web server. Because when users are in the Wireless mode, they must through the IP to enter the setting interface of Web Server. We recommend users to use the Static IP to convenient the setting.
Netmask	When Boot Protocol is “Static IP”, users can set

	subnet mask of M2M-711D in this setting.
Gateway	When Boot Protocol is “Static IP”, users can set gateway of M2M-711D in this setting.
DNS Server	When Boot Protocol is “Static IP”, users can set Domain Name Service Server of M2M-711D in this setting.



[Login](#)
[UserAccount](#)
[Standard Config](#)
[Wireless Config](#)
[OperationMode](#)
[Information](#)

reboot

System
 Operation Mode

NetWork
 Host Name
 Client Name
 Listen Port
 Boot Protocol
 Heart Bit

Ethernet Static IP Config
 Ethernet IP
 Netmask
 Gateway
 DNS Server

<http://www.icpdas.com>


3.3.4 Wireless Config

The different configurations are according to the different Wi-Fi modes. Specifications are shown below:

AP mode:

Wi-Fi Mode	Disable: Transmit data by Ethernet NOT Wi-Fi. AP mode: Transmit data by 802.11b/g, and must have Wi-Fi AP in the site.
SSID	SSID means "Service Set Identifier". It must be the same with the SSID of Wi-Fi AP, and its maximum length is 20.
Channel	It's the Wi-Fi channel, 2.4GHz. It must be the same with the Channel of Wi-Fi AP, and the AUTO mode can set the Channel of Wi-Fi AP automatically.
Encryption	The encryption of Wi-Fi. The Wi-Fi network must have the same encryption cause that the encryptions of Wi-Fi and Wi-Fi AP are must the same with each other.
Passphrase	The security key setting. (For Firmware version v2.X) WEP-64 : The length is 10. WEP-128 : The length is 26. WPA-TKIP : The length is 8~31. WPA2-AES : The length is 8~31. (For (Firmware version v3.X) WPA\WPA2\WPA3 : The length is 8~31.
Boot Protocol (Static IP /DHCP)	M2M-711D supports two kinds of IP modes for Wi-Fi; they are "Static IP" and "DHCP". Users can choose one of them to set the Wi-Fi IP address of M2M-711D.
Wi-Fi IP	Set the Wi-Fi IP.
Wi-Fi Mask	When Boot Protocol is "Static IP", Users can set the Wi-Fi subnet mask of Wi-Fi network in this setting.
Gateway	When Boot Protocol is "Static IP", Users can set the

	gateway of Wi-Fi network in this setting.
DNS Server	When Boot Protocol is “Static IP”, Users can set DNS server of M2M-711D in this setting.
Listen Port (Server mode only)	The listen port of server for the client module connecting in the AP mode. Default Value is 11000.

3.3.5 DDNS Config

When the M2M-711D plays the role of server and the Boot Protocol isn't "Static IP", the client may not connect with the server. We provide a solution, DDNS, for solving this problem. When the IP address of server is changed, the server will register current IP to website that provides DDNS service. The client can connect with the server by domain name that the user registers.


NOTE: Different companies provide different DDNS service register way. In order to make it correctly work, we recommend users to use the DDNS service that provided by DynDNS Company.
DynDNS website: <http://www.dyndns.com/>.

1. Create your Dynamic DNS account

- (1) Please open web browser (ex: IE, Mozilla, etc.) on PC and key in <http://www.dyndns.com> in the Address line and then press Enter.
- (2) Key in "User name" and "Password" and click "Login" button. If the user has not created user account, please click "Create Account" Hyper link to create user account and then login your account.

The screenshot displays the DynDNS.com website interface. At the top, there is a search bar and navigation links: "Why DynDNS.com?", "Services & Pricing", "Support", "Have an account?", and "Sign In". The main banner features the text "Rock solid, scalable DNS that just WORKS" and a "Get Started" button. On the right side, a login form is highlighted with a red border, containing fields for "Username" and "Password", a "Log in" button, and links for "Forgot Your Password?" and "Create an Account". Below the banner, there are two sections: "Free Domain Name" and "Start Your Company & Domain". The "Free Domain Name" section includes a text input field with "example" and a dropdown menu showing "dyndns-mail.com", with an "Add" button. The "Start Your Company & Domain" section includes a text input field with "yourdomain.com" and an "Add" button.

- (3) Click “Service & Pricing” Hyperlink to enter Services page.

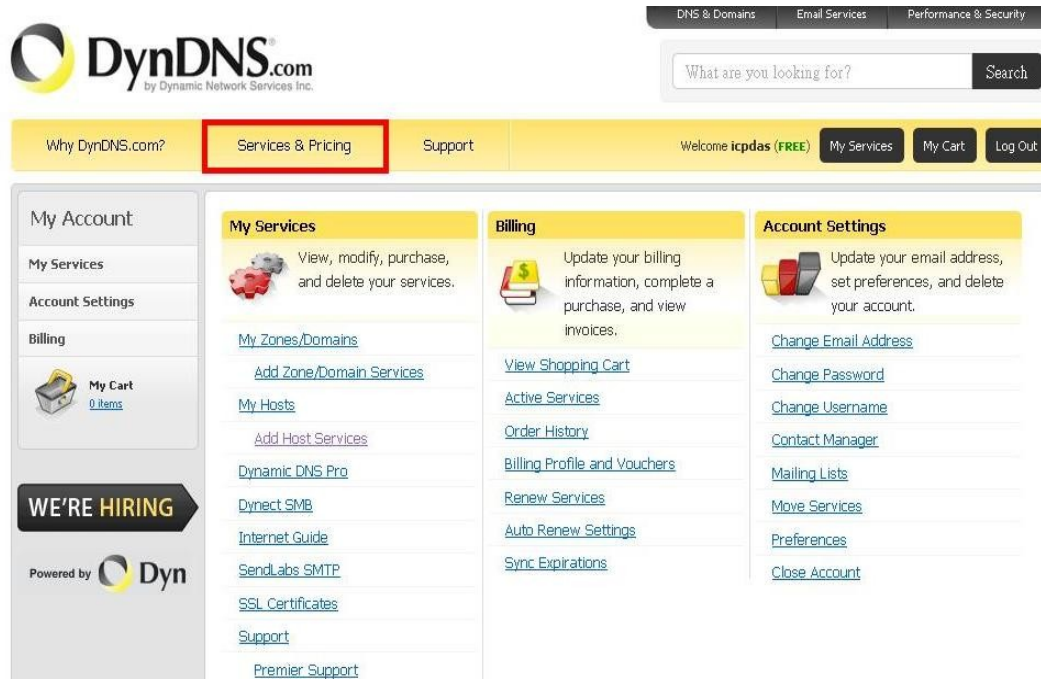

- (4) Click “DynDNS Free” Hyperlink to enter the page of Dynamic DNS Free.



(5) Click “Create Free Hostname” to apply the DDNS.

The screenshot shows the DynDNS.com website interface. At the top, there is a navigation bar with links for "DNS & Domains", "Email Services", and "Performance & Security". Below this is a search bar with the placeholder text "What are you looking for?". A yellow banner across the top contains links for "Why DynDNS.com?", "Services & Pricing", "Support", and a welcome message for user "icpdas (FREE)" with buttons for "My Account", "My Cart", and "Log Out".

The main content area is titled "Dynamic DNS Free". On the left, a sidebar lists various services: "DNS Services" (including Dynamic DNS, Dynamic DNS Pro, Custom DNS, Dynect SMB, Secondary DNS, and Domain Registration), "Email Services", "Performance & Security", "Pricing", and a "My Cart" section showing 0 items. A "NEED HELP?" section at the bottom of the sidebar encourages visiting the forum.

The central content area features the heading "Stay Connected With DynDNS" and a paragraph explaining the service. A prominent blue button labeled "Create Free Hostname" is highlighted with a red rectangular box. Below this button, text promotes "DynDNS Pro" benefits for \$15 per year or \$1.99 monthly. To the right of the main text is a form for creating a hostname, including fields for "Hostname", "Wildcard", "Service Type", "IP Address", and "TTL", along with checkboxes for email routing.

At the bottom of the page, a quote from a user (@WGRyan) praises the company's customer service and products.

M2M-711D user manual (Version 2.20, Mar/2012)
PAGE : 39

M2M-711D user manual (Version 2.20, Mar/2012)
PAGE : 39

Host Services

[↑ My Services](#)

Just signed up for my free domain name with DynDNS! Now I can remote desktop, host web sites at home, and more.

Show us some love!

Hostname	Service	Details	Last Updated
icpdas.dyndns-at-home.com	Host	61.219.167.36	Mar. 29, 2011 4:34 AM

[» Host Update Logs](#)

Add New Host

2. DDNS Config Specification

DDNS	Disable / Enable Users can set the DDNS function enable or disable.
Host Name	Key in your Domain Name (ex: icpdas.dyndns-at-home.com)
User Name	Key in your User Name of registered.
Password	Key in your Password of registered.

DDNS Config

DDNS

Enable

Host name

icpdas.dyndns-at-home.com

User Name

ICPDAS

Password

123456

Save Setting

Default Setting

3.3.6 Com Port Config (Pair-Connection mode)

The setting of Com Port is different between VxServer mode and Pair-Connection mode. In the VxServer mod, M2M-711D can set the Com Port in accordance with the opened Com Port in PC. In the Pair-Connection mode, users must set the Com Port Parameters on their own via web.

Com Port Config provides users set Com Port communication settings between Pair-Connection Server and Pair-Connection Client. For example, when the settings between Pair-Connection Server and Pair-Connection Client are different, the system will set based on server-side in the data transmission. The setting will take effect after reboot.

Port	RS232 / RS485 Choose one of the M2M-711D Com Port communication ways from RS-232 or RS-485.
Remote Port	Set the corresponding com port of Client
Baud Rate	1200 / 2400 / 4800 / 9600 / 19200 / 38400 / 57600 / 115200 bps
Data Bits	7 / 8 data bits
Parity	None / Odd / Even
Stop Bits	1 / 2 stop bits. If the value of Data bit is 7, the Stop Bits will be set 2.
Flow Control	None / Hardware / XonXoff

Com Port Config

Port	RS232	▼
RemotePort	RS232	▼
Baud Rate	115200	▼
Data Bits	8	▼
Parity	None	▼
Stop Bits	1	▼
Flow Control	None	▼
Change Setting		Default Setting

3.3.7 Operation Mode

This mode offer the operation interface of serial communication, users can select the communication settings they want to do at once via this mode, and the setting isn't boot configuration. Thus it will be limited in current operation.

Remote IP (Ethernet Pair-Connection Server only)	Show the current Pair-Connection Client IP.
Port	Show the communication port (RS232/RS485).
Remote Port (Ethernet Pair-Connection Server only)	Show the remote Port assignment.
Baud Rate	Communication rate of Comport (1200 / 2400 / 4800 / 9600 / 19200 / 38400 / 57600 / 115200 bps)
Data Bits	The data length of Com Port communication. (7 / 8 data bits)
Parity	Show the Parity of Com Port (None / Odd / Even).
Stop Bits	Show the Stop Bits of Com Port (1 / 2 stop bits).
Flow Control	Show the flow control of Com Port. (None / Hardware / XonXoff)
Get Status 按鈕 (Ethernet mode only)	Get the current status of communication assignment.

Communication configureg

Remote IP	0.0.0.0
Port	RS232
RemotePort	RS232
Baud Rate	115200
Data Bits	8
Parity	None
Stop Bits	1
Flow Control	None
GetStatus	

3.3.8 Information

- (1) OS version
- (2) XS Version
- (3) Firmware Version
- (4) Wi-Fi Firmware Version
- (5) IP : Show the current IP
- (6) Subnet Mask
- (7) Mac Address
- (8) Wi-Fi Mac Address
- (9) System state:**

Server	"Listen": The system is monitoring. "Communication": Server is communicating with clients.
Client	"Initok": Finish system initial. "try to connect" : Clients try to connect with server. "Login": Clients login successful. "Communication" : Server is

Information

OS Version :	2.2.15[Apr 29 2008]
XS Version :	0.9.3.14
Firmware Version :	V1
Wi-Fi Firmware Version :	ID807b06
System State:	Init ok

Ethernet Config

IP :	192.168.1.217
SubnetMask :	255.255.0.0
Gateway :	192.168.0.254
MacAddress :	00:0D:E0:03:04:56

Wireless Config

IP :	192.168.1.200
SubnetMask :	255.255.0.0
Gateway :	192.168.0.254
Wi-Fi Mac Address :	00:27:13:7F:68:F9

4. VxComm Applications

4.1 VxServer Introduction

The VxServer is a virtual com middleware software. The VxServer with VxComm Driver can create virtual COM ports in Windows and maps them to the serial ports of the GT-541/M2M-710D/M2M-711D devices through the Ethernet, GPRS, 3G and Wi-Fi network. The user's RS-232 client programs need only to change to the virtual COM port to access the serial devices connected to the device servers through the network.




4.2 VxServer Installation

VxServer Software download link:

<http://ftp.icpdas.com/pub/cd/usbcd/napdos/vxserver/software/>

VxServer user manual:

<http://ftp.icpdas.com/pub/cd/usbcd/napdos/vxserver/manual/>

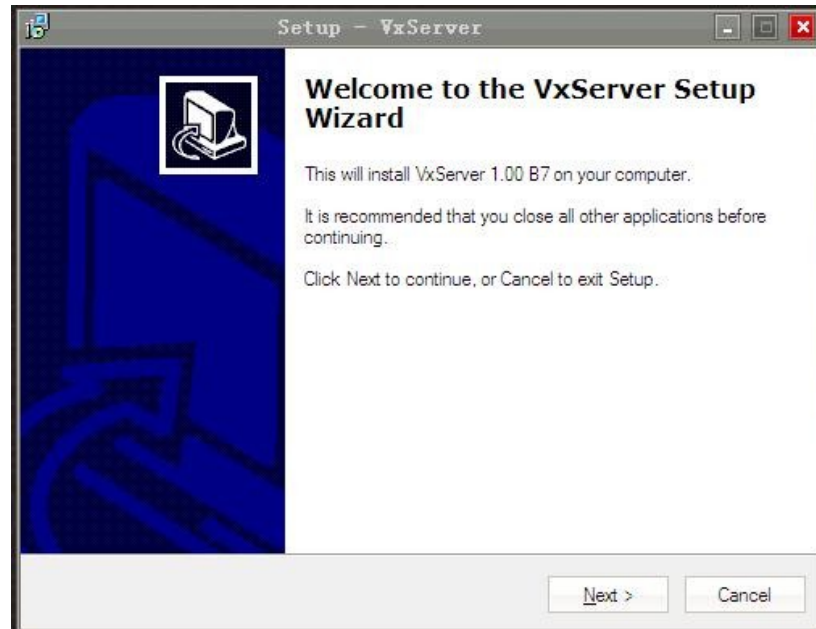

4.3 VxComm Introduction

VxComm(Virtual Com) can create virtual COM ports in Windows and maps them to the serial ports of the M2M-711D devices through the Ethernet / Wi-Fi network. The user's RS-232 client programs need only to change to the virtual COM port to access the serial devices connected to the device servers through the network. Servicemen can maintain remote machines as real as he has been on the spot. That can not only reduce the business travel cost, but also save the time of waiting for maintaining equipments.

4.4 VxComm Driver Installation

Download VxComm Driver:


http://ftp.icpdas.com/pub/cd/8000cd/napdos/driver/vxcomm_driver/

"VxComm2K_v2.11.05_setup.exe" for Windows NT4.0, 2000 /XP/2003 and Vista32 (32-bit)

"VxComm98.exe" for Windows 95/98/ME


Please select the most suitable for your Windows and download

the latest version. And then, run the installer.

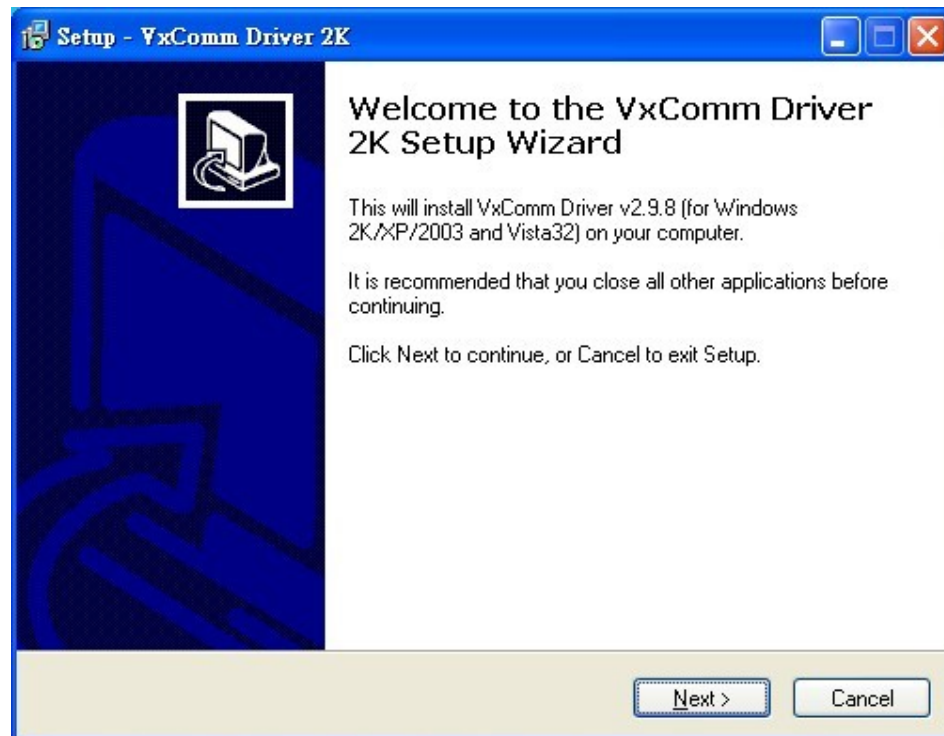

4.5 VxServer Working


Step1: Open VxServer

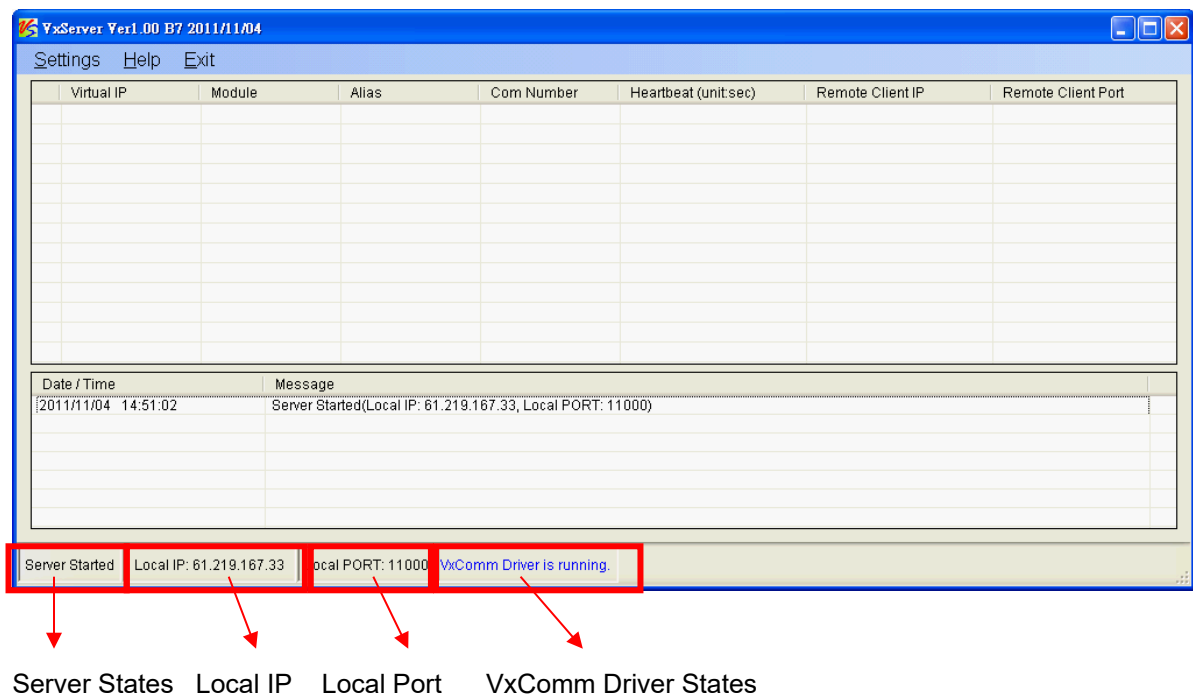


Note: It means successful start if the Server States show

“Server Started”.

Step2: There are M2M-711D modules successful connect. As shown below:

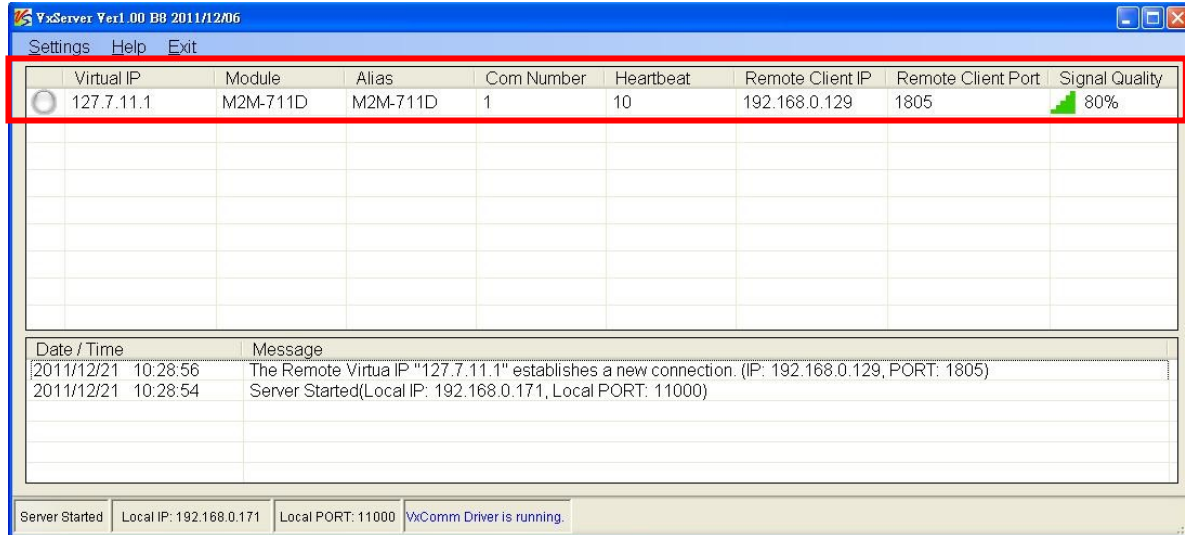


Step3: Open VxComm and add into M2M-711D VxComm Server

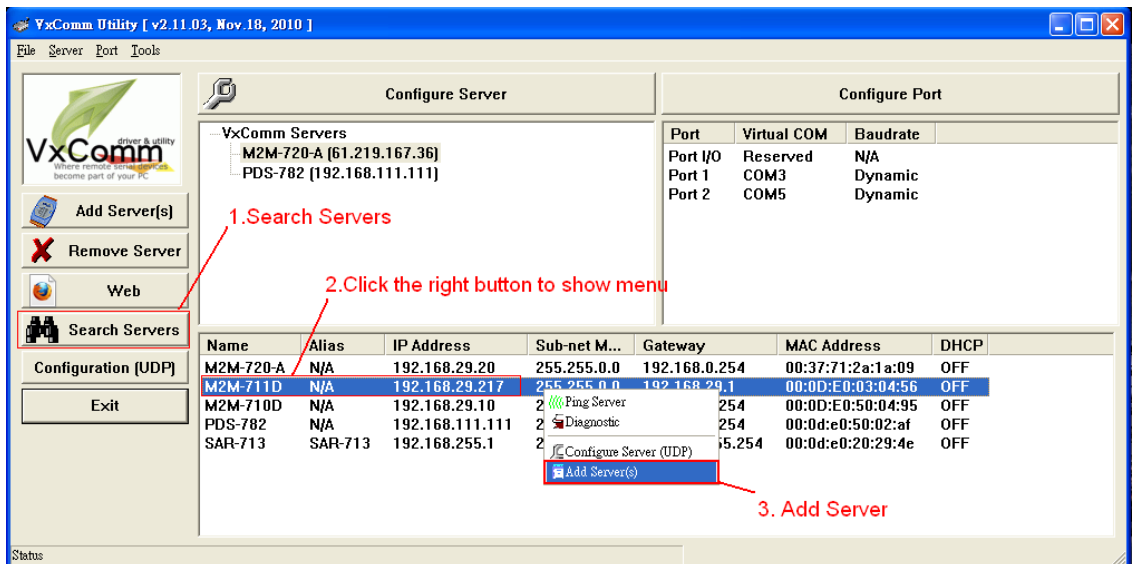


Step4: Double-Click “Port1” and open Port Configuration dialog

window, and then select the suitable Com Port.

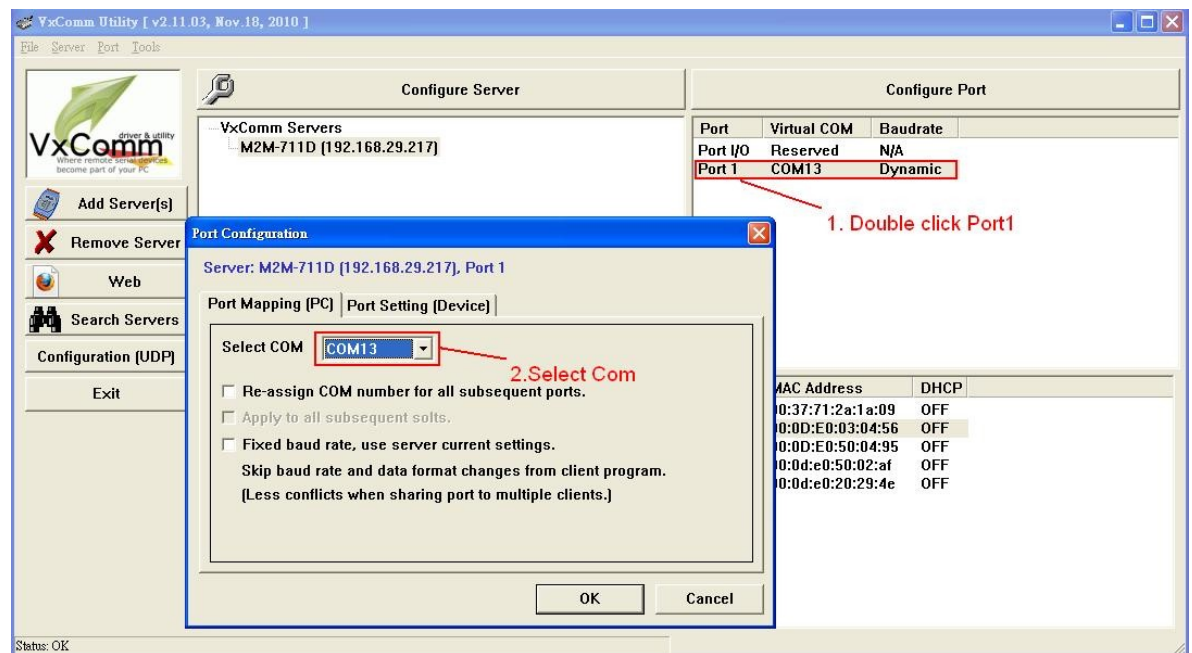


Step5: Reset VxComm Driver to make settings take effect.

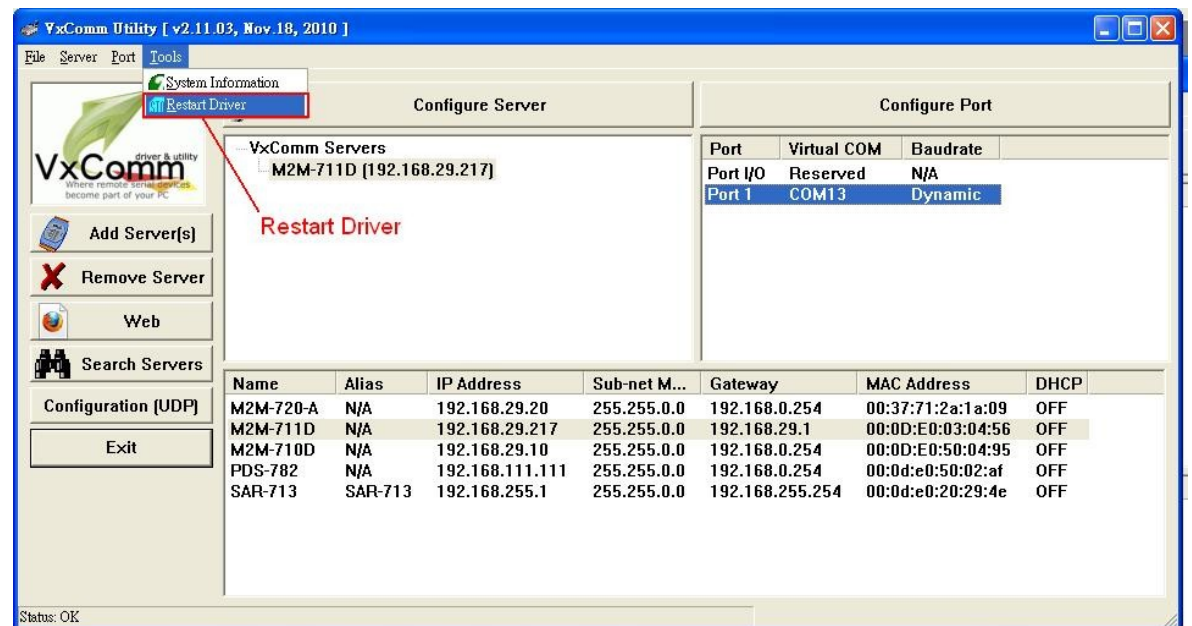

4.6 VxServer Mode Communication Test

Step1: Connect M2M-711D with PC as shown below:

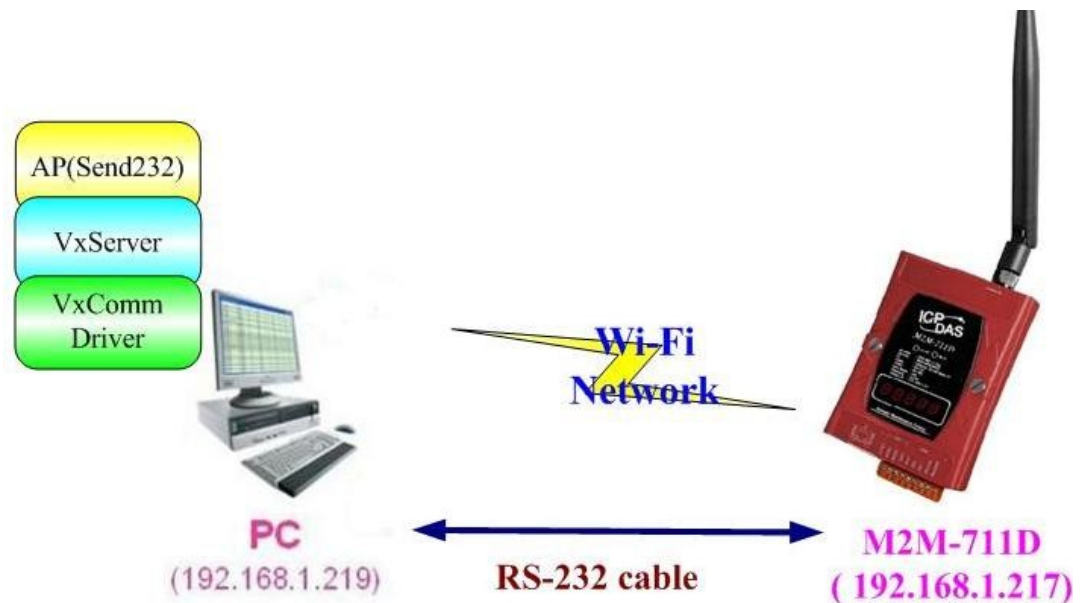


Step2: Assign the M2M-711D's Server Port1 to PC's virtual Com 13. Please refer to section 4.5.

Step3: Connect VxServer with M2M-711D: In the Standard Config setting web of M2M-711D, users have to set Server IP (For example, the IP in the above diagram is 192.168.1.219) and click "Save Setting" to finish connection.

Step4: Use Send232 Program to test communication. (Download link:

http://ftp.icpdas.com/pub/cd/8000cd/napdos/7188e/tcp/pcdiag/source/send232.vb6_2.0.1) Open two Send232 programs, one use Com1 (connect with M2M-711D), the other use Com12 (produced by VxComm driver). Press the Send button respectively and you can see the two Send232 programs send the data with each other. As shown below:

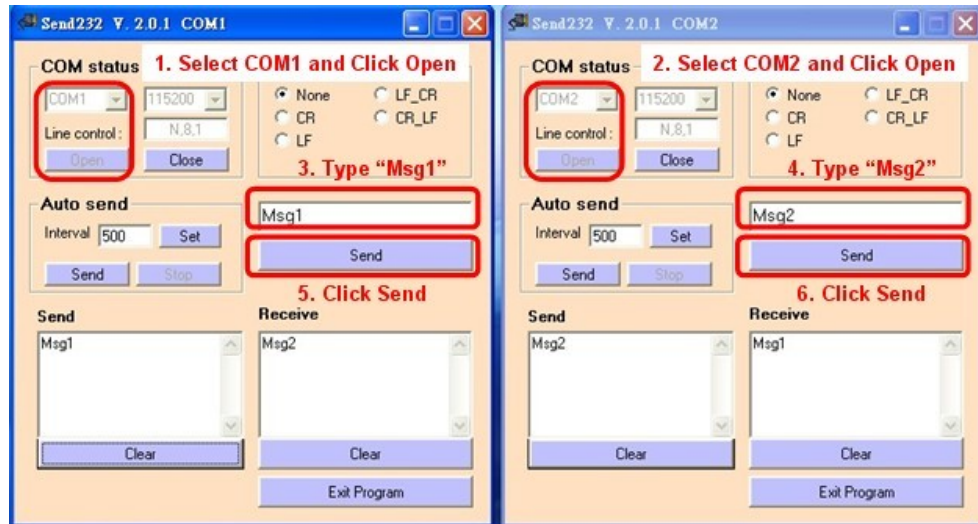

5. Firmware update

The update must be performed using ICP DAS's MiniOS7 Utility with an Ethernet cable.

You can check the current software version under [Information] on the web server.

The latest firmware available on the ICP DAS official website includes fixes for known issues, so it is recommended to update to the newest version.


The MiniOS7 Utility can be searched for, downloaded, and installed from the ICP DAS official website.

Information

OS Version :	2.2.33[Jan 14 2019]
XS Version :	0.9.3.14
Firmware Version :	V2.2
Wi-Fi Firmware Version :	5.2.1
System State:	Init ok

Step 1. Before performing the firmware update, switch the DIP switch on the back of the device to the [init] position. Make sure your personal PC and the M2M-711D module are connected within the same network structure (refer to Section 3.1 for details, as the procedure is the same).


Step 2. After powering on the device, the LED will display the IDLE time. At this point, open the MiniOS7 Utility and click [Connection] in the upper-left corner.

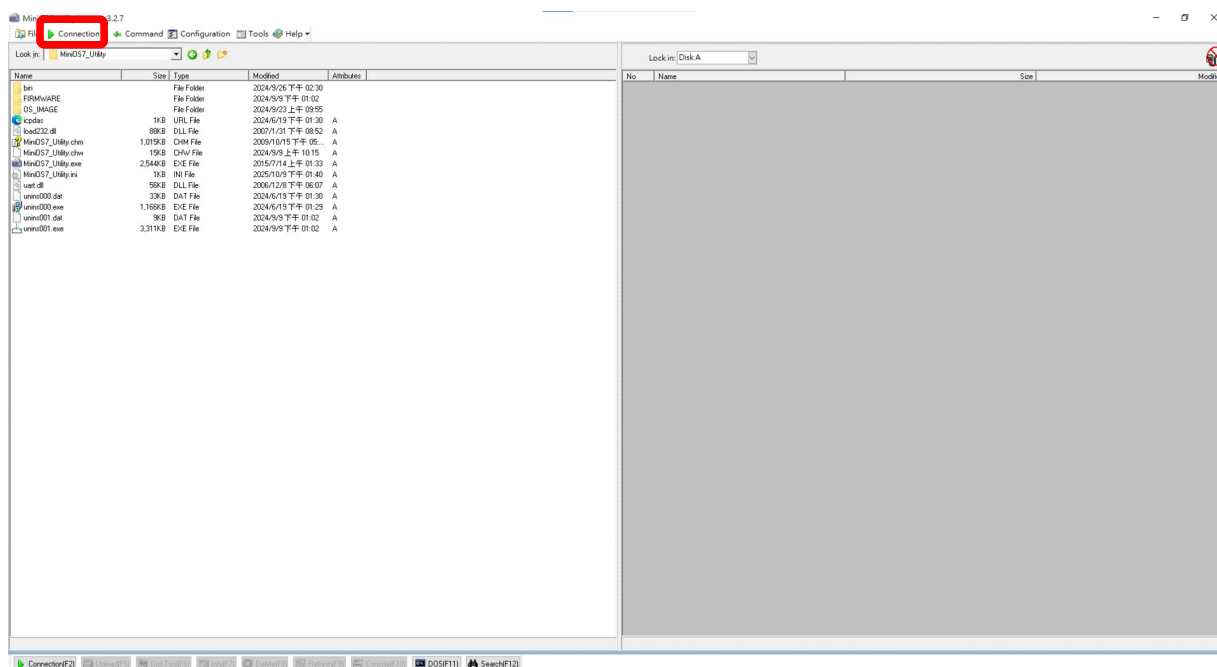


Step 3. Select UDP as the connection type (blue box).

The IP address (green box) is set to 192.168.1.217 by default at the factory. If you have previously configured the IP address on the web server, use your configured value instead.

If you forgot the IP address, you can switch back to Normal mode to check the address shown on the LED display, or reset the device to its factory default settings. The Port should always be set to 23, then click [OK].

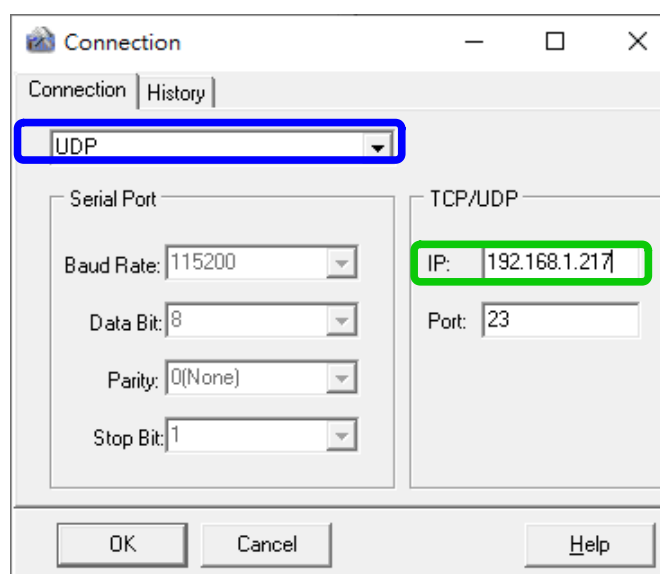

Step 4. After clicking [OK], if several files appear on the right side of the interface, it means the system is ready to update the firmware. If a connection failed error message appears after clicking [OK], please return to Step 3 and verify whether the IP address settings are correct.

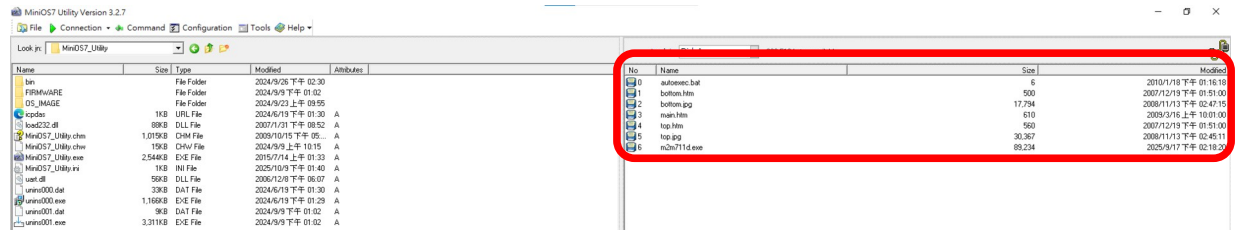


Step 5. Next, download the latest firmware from the ICP DAS official website.

Please note: If the version shown under [Information] begins with v2, download the firmware package that starts with v2. If the version begins with v3, download the firmware package that starts with v3.


Information

OS Version :	2.2.33[Jan 14 2019]
XS Version :	0.9.3.14
Firmware Version :	V2.2
Wi-Fi Firmware Version :	5.2.1
System State:	Init ok


Step 6. After the download is complete, return to the MiniOS7 Utility. Click [Look in] in the upper-left corner and navigate to the folder where the downloaded file is located. Inside the compressed file, there will be [7] files.

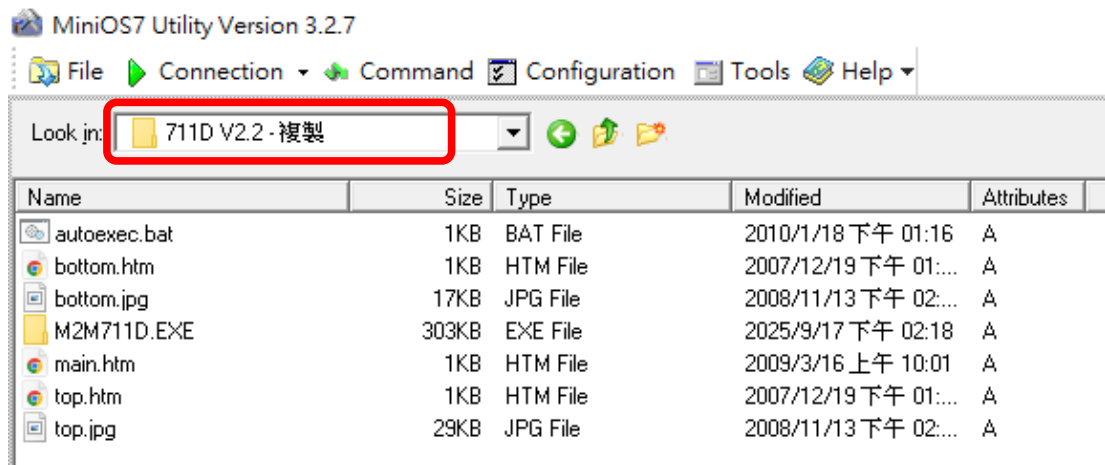

Step 7. On the right side of the MiniOS7 Utility window, right-click to open the menu and select [Erase disk].
Then click [Yes] to confirm and erase the disk.


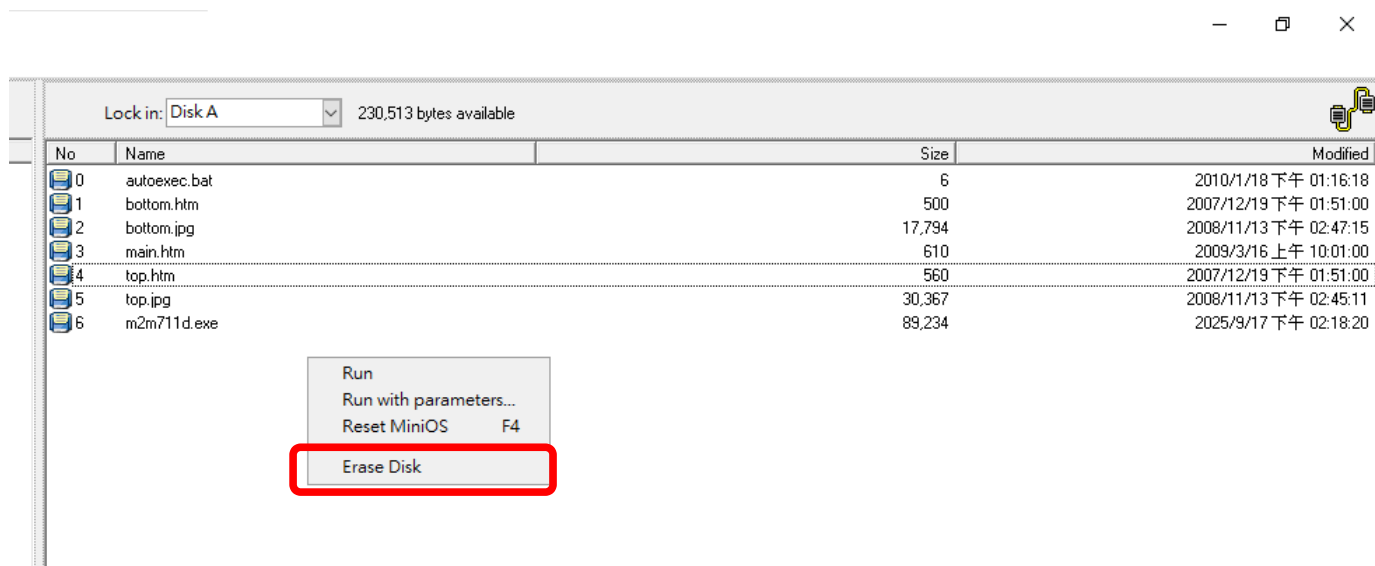


Step 8. Return to the left side of the MiniOS7 Utility, select all [7] files, right-click, and choose [Upload].
Wait until all files have been successfully transferred, then you can close the Utility.

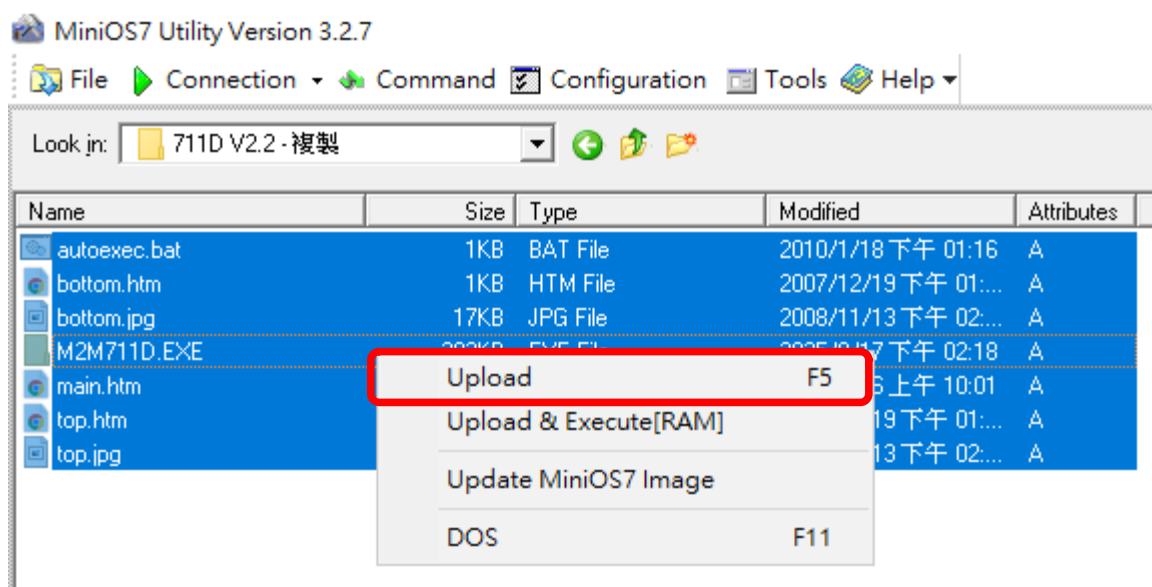

Step 9. Power off the device, then switch the DIP switch on the back of the M2M-711D back to the [Normal] position. The firmware update is now complete.

6. Troubleshooting

Item	Trouble State	Solution
1	LED stay on 	DNS Server error 1. Please check the net configuration 2. Please check the Server address 3. Please try to use IP
2	Client login, but it cannot Pair Connection	1. Inspects the line 2. Is M2M-711D online?
3	Continuously heavy starting	Reboot both of RM711Ds server and client
4	LED Conn. twinkled	1. Check Server IP 2. Check net
5		Check the Client Name of Server and the Host Name of Client are the same.
6.		The M2M-711D can't ping to the server in AP mode. Please check the Channel, SSID, Encryption and Passphrase of Wireless Config page are the same with Wi-Fi AP.
7.		The M2M-711D can't ping to the server IP in AP mode. Please check Server IP and Wireless Configuration.
8.	LED:State Code 	State Code : The code for rebooting. Ex : 01 , Enable the initializing function.

7. FAQ

Q1: If I forget the M2M-711D's IP, how can I set and operate the M2M-711D by web browser?

A1: Before the host PC connect to the M2M-711D, you must know the Ethernet IP of M2M-711D. There are two ways to set the IP:

Method1: Reboot the M2M-711D (Section 2.4)

If the M2M-711D is in AP mode, the Ethernet IP would be shown on LED after "SET IP" as the following figures. The Ethernet IP of the example is 192.168.1.217.

8. 8. 8. 8. 8.
8. 8. 8. 8. 8.
8. 8. 8. 8. 8.
8. 8. 8. 8. 8.
8. 8. 8. 8. 8.

If the M2M-711D is in Ethernet mode, the Ethernet IP would be shown on LED after "11111". The Ethernet IP of the example is 192.168.1.217.

8. 8. 8. 8. 8.
8. 8. 8. 8. 8.
8. 8. 8. 8. 8.
8. 8. 8. 8. 8.
8. 8. 8. 8. 8.

Method2: Restore the M2M-711D factory default setting. Please refer to section 2.3.

(Default setting – User: root, Password: icpdas, IP = 192.168.1.217)

Q2: The M2M-711D can't connect with VxServer in the AP mode or Ethernet mode.

A2: Please follow the following steps to check that the network configuration is correct.

Step1: Check the IP of VxServer and M2M-711D is no repeat with other computers.

Step2: Please confirm the network configurations are correct. The configurations include IP Address, Net Mask, Gateway and DNS Server. If the configurations are all correct, it should respond to the ping command from PC.

The screenshot displays the ICP DAS web management interface. At the top, there is a yellow header with the 'ICP DAS' logo. Below the header, a left sidebar contains navigation links: 'Login', 'User Account', 'Standard Config', 'Wireless Config', 'Operation Mode', and 'Information'. A 'reboot' button is located below these links. The main content area is titled 'Wireless' and contains several configuration fields: 'Wireless Mode' (set to 'Wi-Fi Mode'), 'SSID' (set to 'ICPDAS'), 'Channel' (set to 'AUTO'), 'Encryption' (set to 'WEP-64'), 'Passphrase' (set to '0123456789'), and 'Boot Protocol' (set to 'Static IP'). Below these fields is a section titled 'Static Wi-Fi IP Config' which is highlighted with a red rectangle. This section includes four input fields: 'Wi-Fi IP' (192.168.77.88), 'Wi-Fi Mask' (255.255.0.0), 'Wi-Fi GateWay' (192.168.0.254), and 'DNS Server' (168.95.1.1). At the bottom of this section are two buttons: 'Save Setting' and 'Default Setting'. The footer of the interface shows the URL 'http://www.icpdas.com'.

Step3: Please confirm that the following settings are correct.

- (1)** “Server IP” of “Standard Config” web page is the same with VxServer’s IP.



ICP DAS

[Login](#)
[UserAccount](#)
[Standard Config](#)
[Wireless Config](#)
[DDNS Config](#)
[ComPort Config](#)
[OperationMode](#)
[Information](#)

reboot

System
 Operation Mode: VxServer

NetWork
 Host Name: M2M-711D
 Sation ID: 1
 Connect to Server by: IP
 Server Name: www.icpdas.com.tw
 Server IP: 192.168.0.171
 Communication Port: 11000
 Boot Protocol: StaticIP
 Heart Bit: Enable

Ethernet Static IP Config (Only Web Page Config)
 Ethernet IP: 192.168.1.217
 Netmask: 255.255.0.0
 Gateway: 192.168.0.254

- (2)** The “Communication Port” of VxServer and M2M-711D are the same.

The screenshot displays the VxServer application window. At the top, the title bar reads "VxServer Ver1.00 B8 2011/12/06". Below the title bar is a menu bar with "Settings", "Help", and "Exit". The main area is divided into two sections. The upper section is a table with columns: Virtual IP, Module, Alias, Com Number, Heartbeat, Remote Client IP, Remote Client Port, and Signal Quality. The first row shows a virtual machine with IP 127.7.11.1, Module M2M-711D, Alias M2M-711D, Com Number 1, Heartbeat 10, Remote Client IP 192.168.0.129, Remote Client Port 1805, and a signal quality of 80% (indicated by a green bar chart). The lower section is a log window with columns "Date / Time" and "Message". It contains two entries: "2011/12/21 10:28:56 The Remote Virtua IP \"127.7.11.1\" establishes a new connection. (IP: 192.168.0.129, PORT: 1805)" and "2011/12/21 10:28:54 Server Started(Local IP: 192.168.0.171, Local PORT: 11000)". At the bottom, a status bar shows "Server Started", "Local IP: 192.168.0.171", "Local PORT: 11000", and "VxComm Driver is running."

Virtual IP	Module	Alias	Com Number	Heartbeat	Remote Client IP	Remote Client Port	Signal Quality
127.7.11.1	M2M-711D	M2M-711D	1	10	192.168.0.129	1805	80%

Date / Time	Message
2011/12/21 10:28:56	The Remote Virtua IP "127.7.11.1" establishes a new connection. (IP: 192.168.0.129, PORT: 1805)
2011/12/21 10:28:54	Server Started(Local IP: 192.168.0.171, Local PORT: 11000)


Server Started Local IP: 192.168.0.171 Local PORT: 11000 VxComm Driver is running.

- (3) The “Operation Mode” is VxServer


Q3: Server and Client can't establish Com Port connection.

A3: Please check following steps:

Setp1: Check M2M-711D has finished the registration of VxServer, and the signal is green.

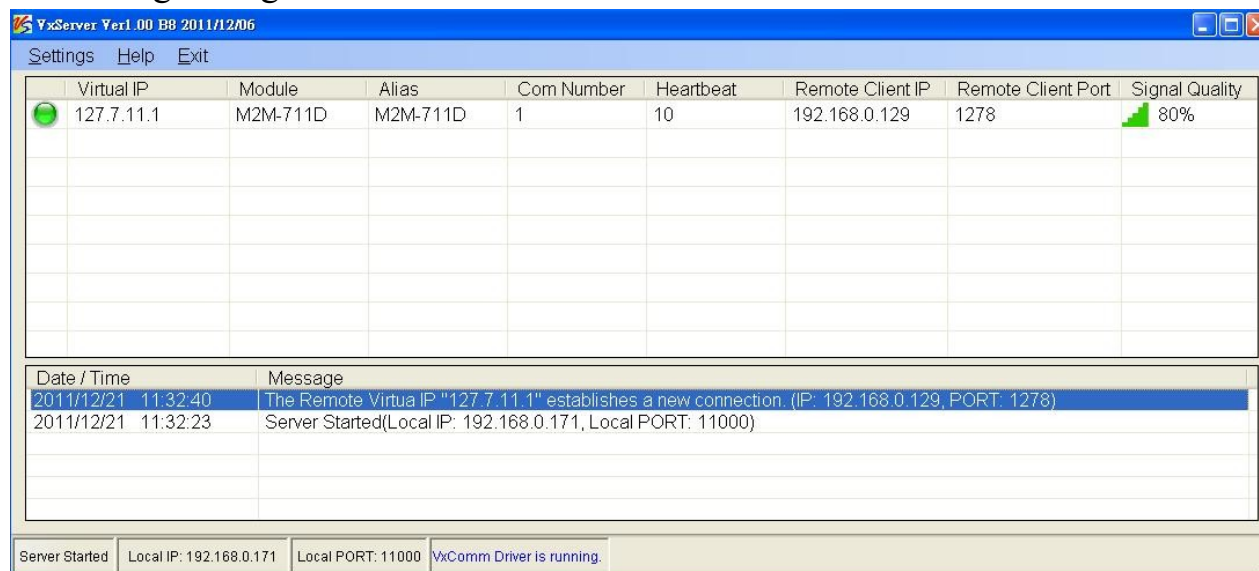


Step2: Check the 5-Digit 7 Segment LED Display of M2M-711D shows correct Com Port setting.

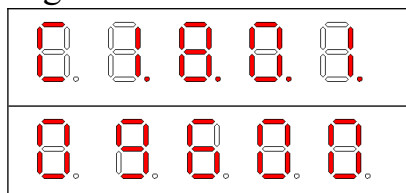


Step3: Check the connection wiring of M2M-711D and Com Port is correct. It has to take jumper connected method unless the Com Port connection is a DCE device. In other words, if the Com Port connection device is a DCE device it doesn't have to use jumper connected.


8. Dimensions

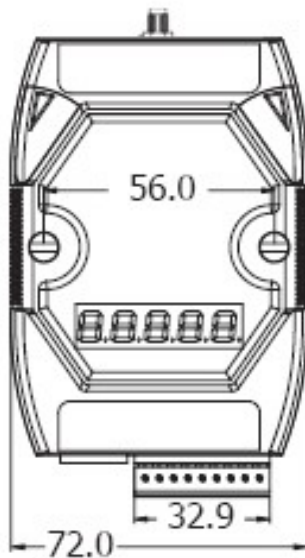


Front View

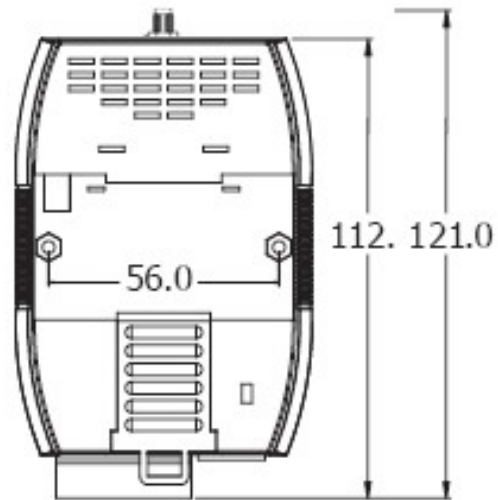


Rear View




Top View

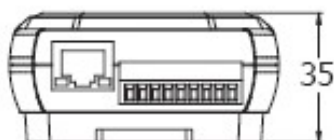

Bottom View

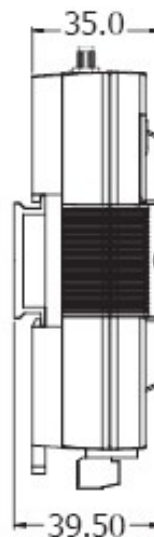


Din-Rail Mounting Bracket

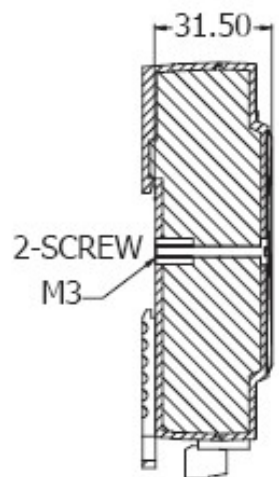


Side View

Installation

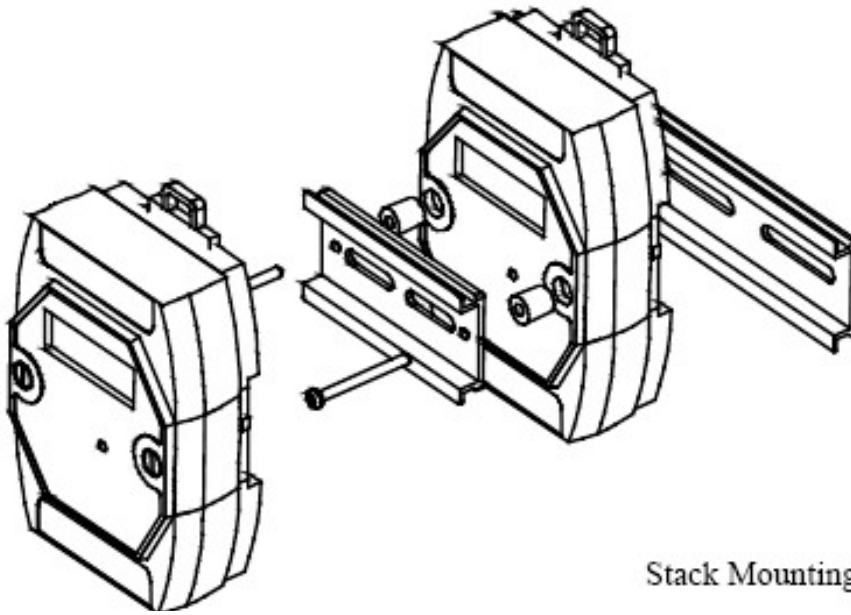

Stack Mounting

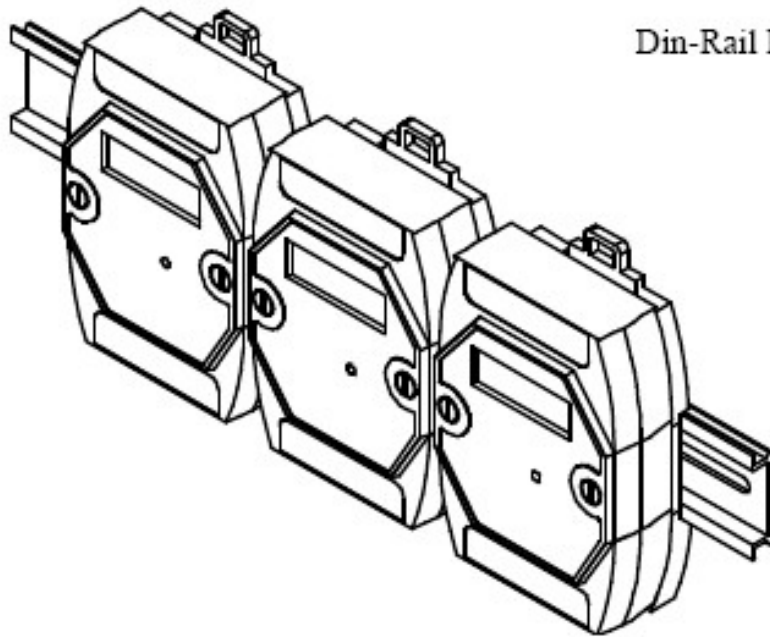

Din-Rail Mounting

9. Frame Ground

Electronic circuits are constantly vulnerable to Electro Static Discharge (ESD), which becomes worse in a continental climate area. M2M-711D module feature a new design for the frame ground, which provides a path for bypassing ESD, allowing enhanced static protection (ESD) capability and ensures that the module is more reliable.

It is recommended that the Frame Ground of the M2M-711D module is corrected to the earth ground, such as the ground of an AC power supply, to provide better ESD protection for the module.

The M2M-711D module is designed with two Frame Ground contact points, Frame-Ground-A and Frame-Ground-B, as shown in the figure below. When mounted to a DIN rail, Frame-Ground-B and the DIN rail are in contact. Thus, protection can be achieved by also connecting the DIN rail to earth ground.

