

## Classification:

Software Development for I-7000/M-7000 series

### Question


I want to use Modbus or Modbus TCP/IP protocol to connect to I-7000 & I-87K remote I/O modules. How?

### Answer

I-7188XG & I-8417/8817 can be a Modbus RTU serial converter of I-7000 & I-87K series I/O modules.



I-7188EG & I-8437/8837 can be a Modbus RTU serial & TCP/IP converter of I-7000 & I-87K series I/O modules.

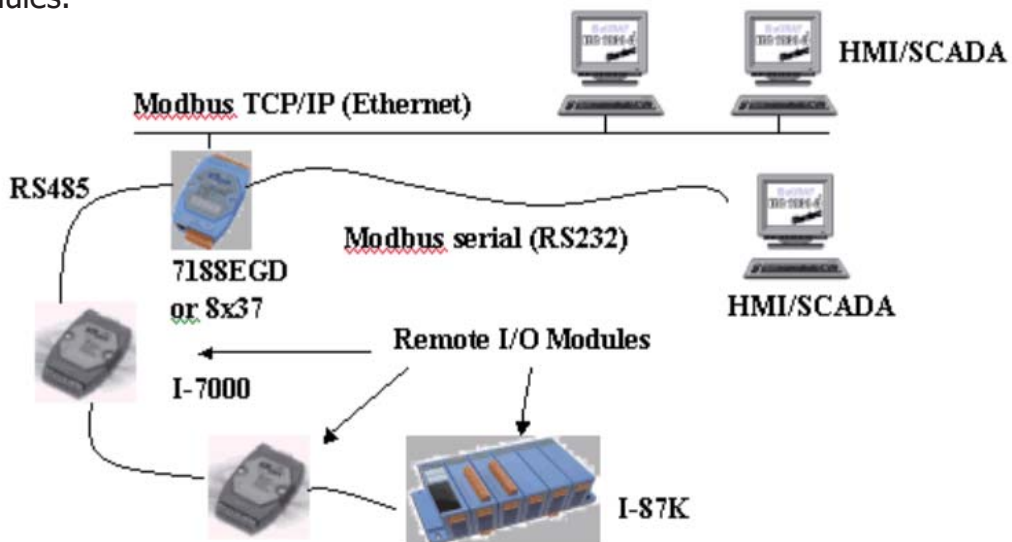

Please refer to

[http://www.icpdas.com/en/product/guide+Software+Development\\_Tools+ISaGRAF](http://www.icpdas.com/en/product/guide+Software+Development_Tools+ISaGRAF) &

1. Chapter 4.3 & Chapter 6 of the User's Manual Of ISaGRAF Embedded Controllers or
2. I-7188/I-8000 CD-ROM: \napdos\isagraf\8000\english\_manu\User\_Manual\_I\_8xx7.pdf or
3. Download ISaGRAF User's Manual at

<http://www.icpdas.com/en/download/index.php?nation=US&kind1=&model=&kw=isagraf>