

Classification	ISaGRAF English FAQ-041						
Author	Chun Tsai	Version	1.0.0	Date	Aug. 2007	Page	1 / 2

## How to connect PC / HMI to a Redundancy system with a single IP address?

Two WinCon-8347/8747 & WinCon-8346/8746 can setup as one redundancy system. The PC/HMI/SCADA software can connect to one I-7188EX-MTCP to convert Modbus TCP/IP protocol to become Modbus RTU RS-485 protocol and then to these two redundancy controllers as below figures. Then the HMI software running on PC can use only one target IP address (I-7188EX-MTCP's IP) to link to the redundancy system.

Click the following link for more information about products.

I-7188EX-MTCP Modbus Gateway ([Link](#))


Redundancy System (refer to ISaGRAF [FAQ-036](#))

NS-205/NS-208 Ethernet Switch ([Link](#))

M-7000 I/O Modules ([Link](#))

**Figure 1:**

### PC / HMI Connecting to a Redundancy system with a single IP address

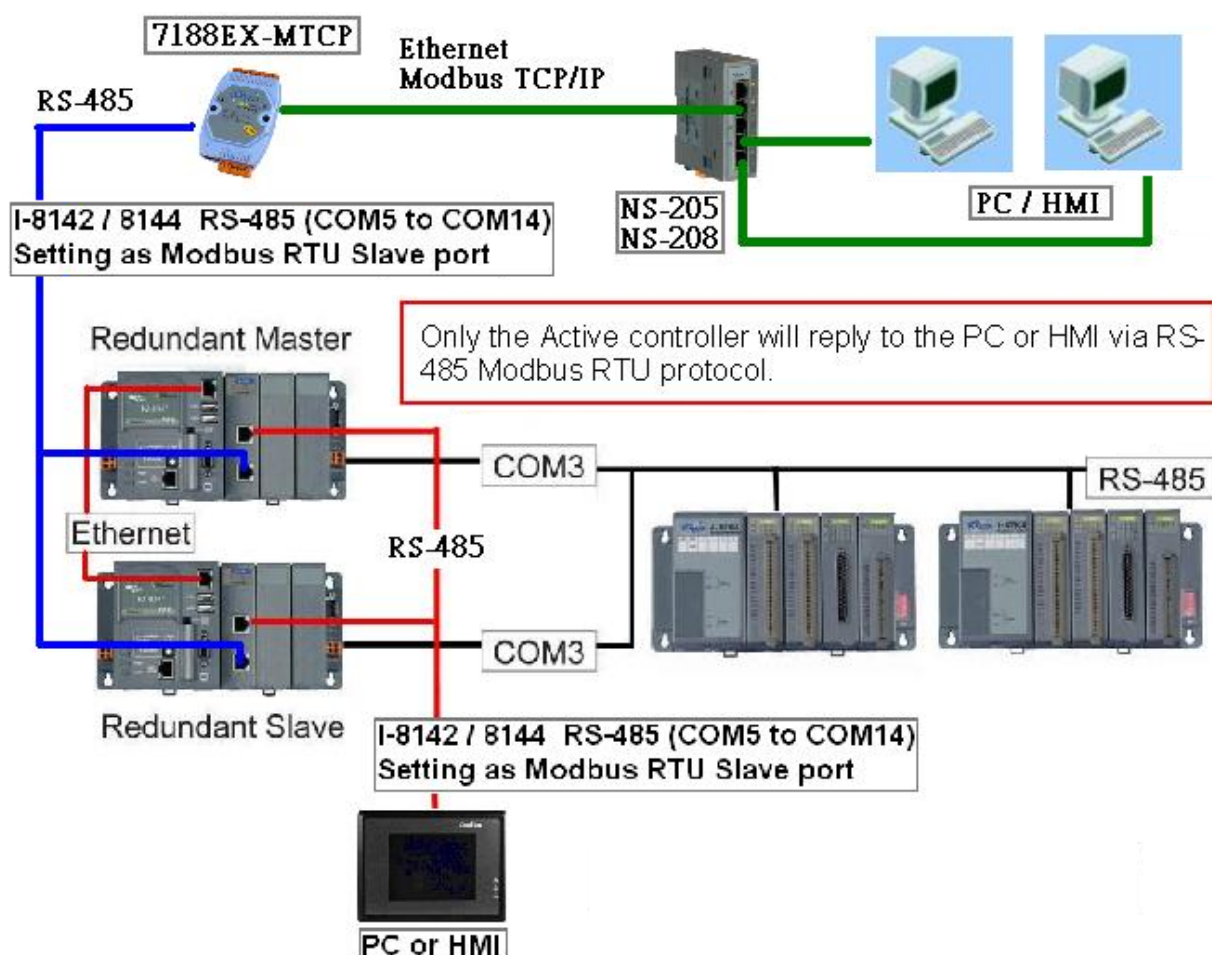


Classification	ISaGRAF English FAQ-041						
Author	Chun Tsai	Version	1.0.0	Date	Aug. 2007	Page	2 / 2

**Figure 2:**

The redundancy system supports not only I-87K I/O in I-87K4/5/8/9 base, but also M-7000 series I/O modules. [http://www.icpdas.com/en/product/guide+Remote\\_I\\_O\\_Module\\_and\\_Unit+RS-485\\_I\\_O\\_Modules+I-7000](http://www.icpdas.com/en/product/guide+Remote_I_O_Module_and_Unit+RS-485_I_O_Modules+I-7000)

Two redundancy WinCon-8x47 / WinCon-8x46 can connect their LAN1 to LAN1 and also LAN2 to LAN2. If one cable is damaged, the other one still works.

### PC / HMI Connecting to a Redundancy system with a single IP address

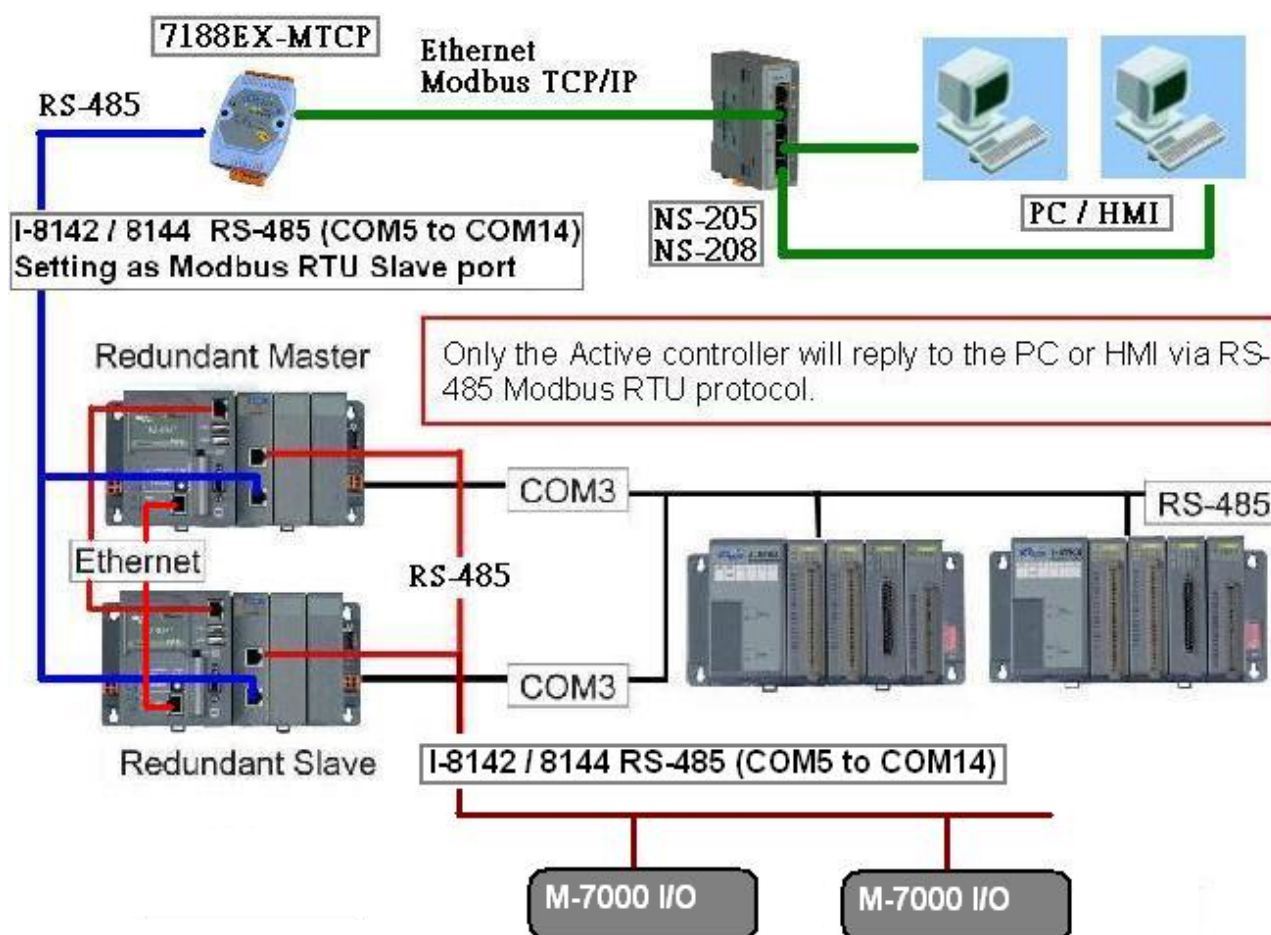

Click the link for more ISaGRAF FAQ:

<http://www.icpdas.com/en/faq/index.php?kind=280#751>