

Classification	ISaGRAF FAQ-105						
Author	Chun Tsai	Version	1.0.0	Date	Aug. 2010	Page	1/ 11

## Program 8-Channel PWM Output Board: I-8088W or I-87088W or I-7088 in the ISaGRAF PAC.

[Download FAQ-105 Demo](#)

The following ISaGRAF PAC support I-8088W I/O board since the following driver version.

WP-8xx7: Ver. 1.05	iP-8xx7: Ver. 1.02
VP-25W7/23W7: Ver. 1.02	XP-8xx7-CE6: Ver. 1.02

The following ISaGRAF PAC support I-87088W I/O board and I-7088 remote I/O module since the following driver version.

WP-8xx7: Ver. 1.24	iP-8xx7: Ver. 1.08
VP-25W7/23W7: Ver. 1.15	XP-8xx7-CE6: Ver. 1.04
uPAC-7186EG: Ver. 1.11	

Please visit

<http://www.icpdas.com/en/download/show.php?num=368&nation=US&kind1=&model=&kw=isagraf> to download the newest driver of the ISaGRAF PACs.

I-8088W and I-87088W and I-7088 support 8-channel PWM outputs. The duty range (High/ High+Low) of the PWM output signal can be from 0.1 to 99.9%. Its output frequency in the ISaGRAF PAC is from 1 Hz to 100KHz. I-8088W and I-87088W and I-7088 support two PWM output modes, one is the "Continuous" mode. It outputs always. The other is the "Burst" mode. It outputs the required pulse count and then stop. Please refer to <http://www.icpdas.com/en/product/I-8088W-G> for other I-8088W and I-87088W specifications.

For I-7088, refer to <http://www.icpdas.com/en/product/I-7088-G>


The ISaGRAF PAC can use I-8088W only in its I/O slot 0 to slot 7. (XP-8xx7-CE6 doesn't have slot 0). While I-87088W can be plugged in the I/O slot 0 to 7 or be used as RS-485 remote I/O. I-7088 can be used as remote I/O only.

I-87088W and I-7088 support not only the 8-Ch. PWM outputs but also supports 8-Ch. D/I (or 8-Ch. D/I Counters).




Classification	ISaGRAF FAQ-105						
Author	Chun Tsai	Version	1.0.0	Date	Aug. 2010	Page	3/ 11

Install the C-function blocks - “i\_8088w”, “i\_87088” and “pwm87088”:

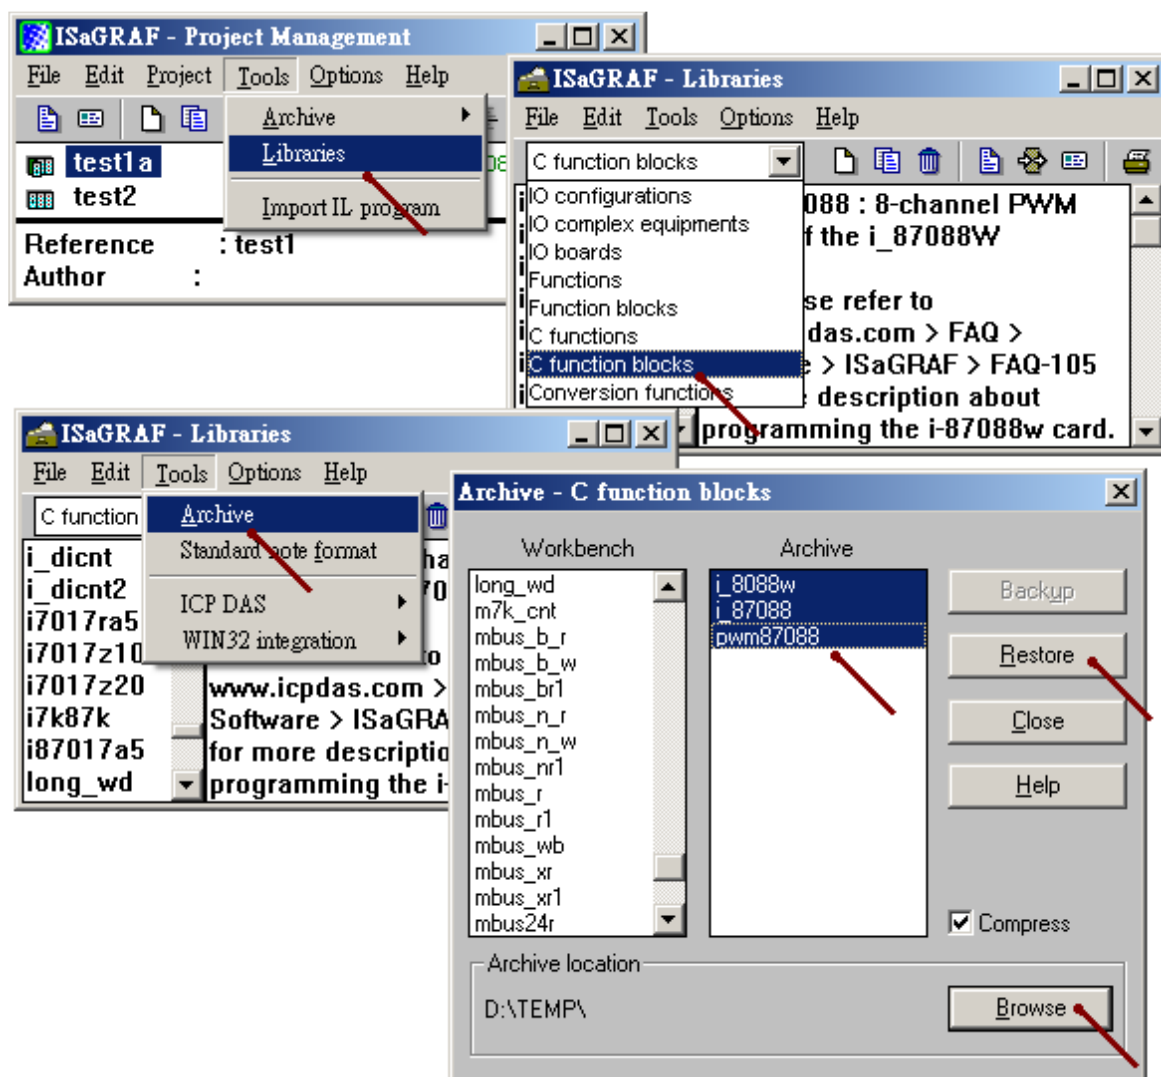

Classification	ISaGRAF FAQ-105						
Author	Chun Tsai	Version	1.0.0	Date	Aug. 2010	Page	4/ 11

Install the I/O complex-equipments - "i\_87088w":

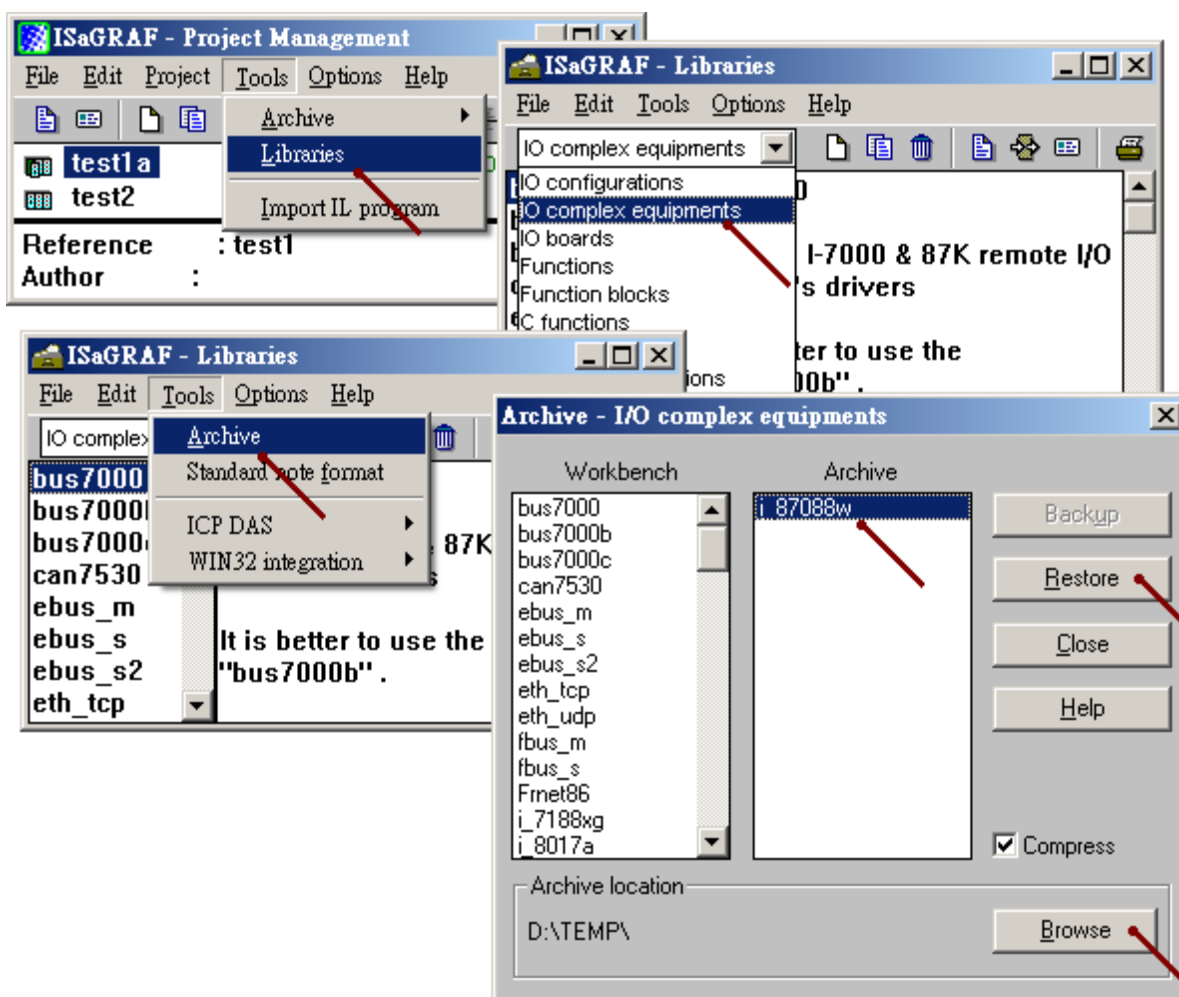


Classification	ISaGRAF FAQ-105						
Author	Chun Tsai	Version	1.0.0	Date	Aug. 2010	Page	5/ 11

## 1.1: Using I-8088W

To use I-8088W, first connect the “i\_8088w” I/O board in the IO connection windows.

The ISaGRAF demo program is the “xpdmo75”. You may visit

<http://www.icpdas.com/en/faq/index.php?kind=280#751> > FAQ-105 to download it. Then follow the steps listed in the section 9.5 of the ISaGRAF user's manual to restore the “wpdmo75.pia” to your PC/ISaGRAF.

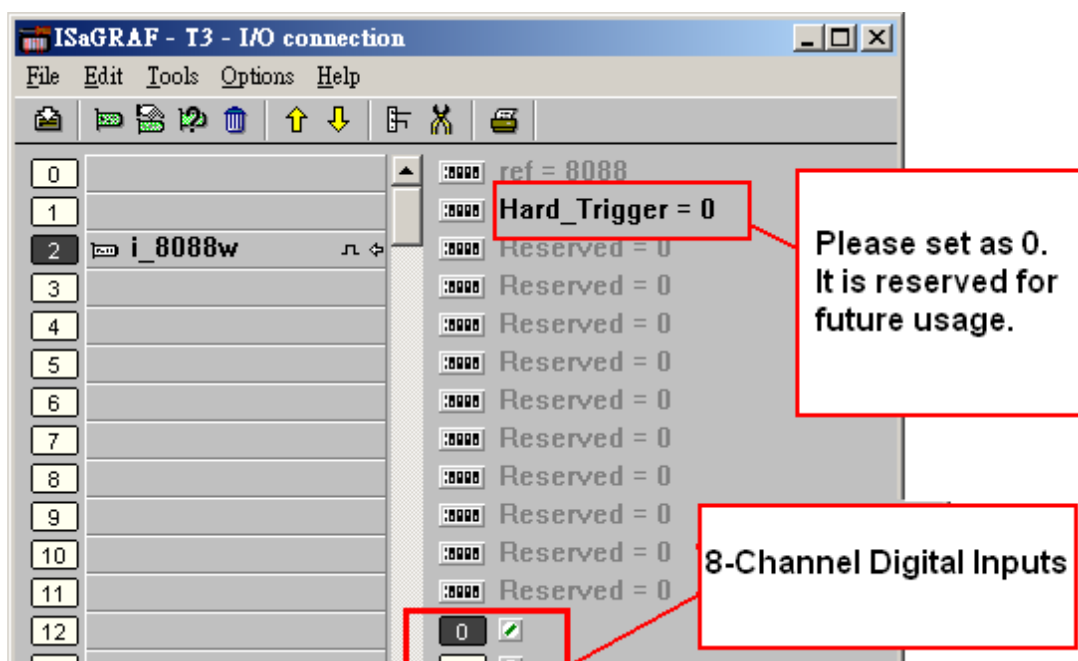


Classification	ISaGRAF FAQ-105						
Author	Chun Tsai	Version	1.0.0	Date	Aug. 2010	Page	6/ 11

Then using the c-function block “i\_8088w” to control the PWM output for each channel.

The “Freq\_” and “Duty\_” can be dynamically modified when the PWM mode is “Continuous” mode and “Run\_” is True (Started). The frequency and duty of the PWM output will change to the required value.

If the “Cnt\_” value is modified to a different value when “Run\_” is True, the PWM output will automatically stop first and then start immediately to output the required PWM pulse (no matter it is continuous mode or burst mode).

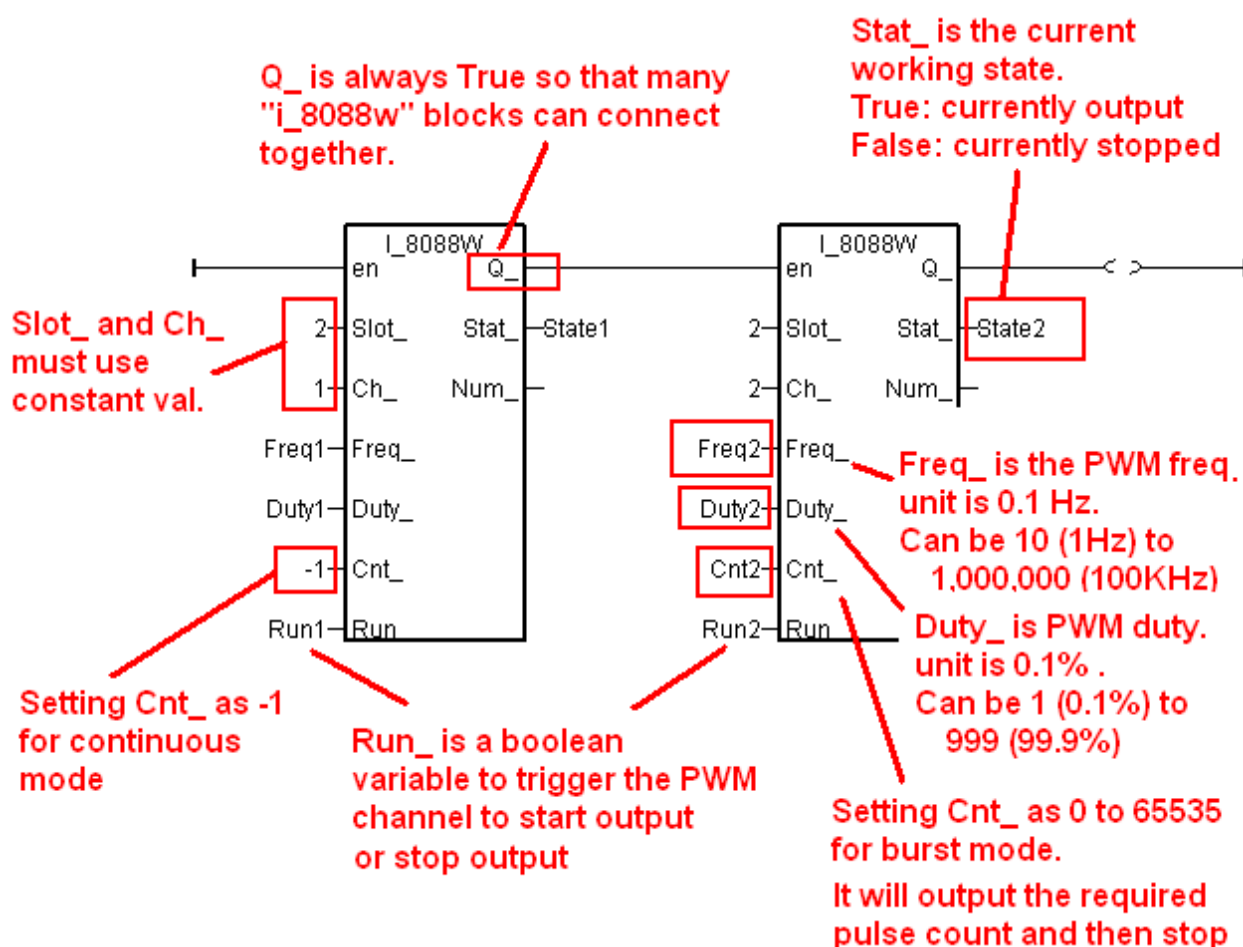


Classification	ISaGRAF FAQ-105						
Author	Chun Tsai	Version	1.0.0	Date	Aug. 2010	Page	7/ 11

## 1.2: Using I-87088W as Local I/O

To use I-87088W as local I/O (in the I/O slot number 0 to 7 in the ISaGRAF PAC), first connect the “i\_87088w” I/O complex-equipment in the IO connection windows.

The ISaGRAF demo program is the “xpdmo75A”. You may visit <http://www.icpdas.com/en/faq/index.php?kind=280#751> > FAQ-105 to download it. Then follow the steps listed in the section 9.5 of the ISaGRAF user's manual to restore the “wpdmo75.pia” to your PC/ ISaGRAF.

(Please refer to the section 1.3 in this document for using I-87088W and I-7088 as RS-485 remote I/O module)

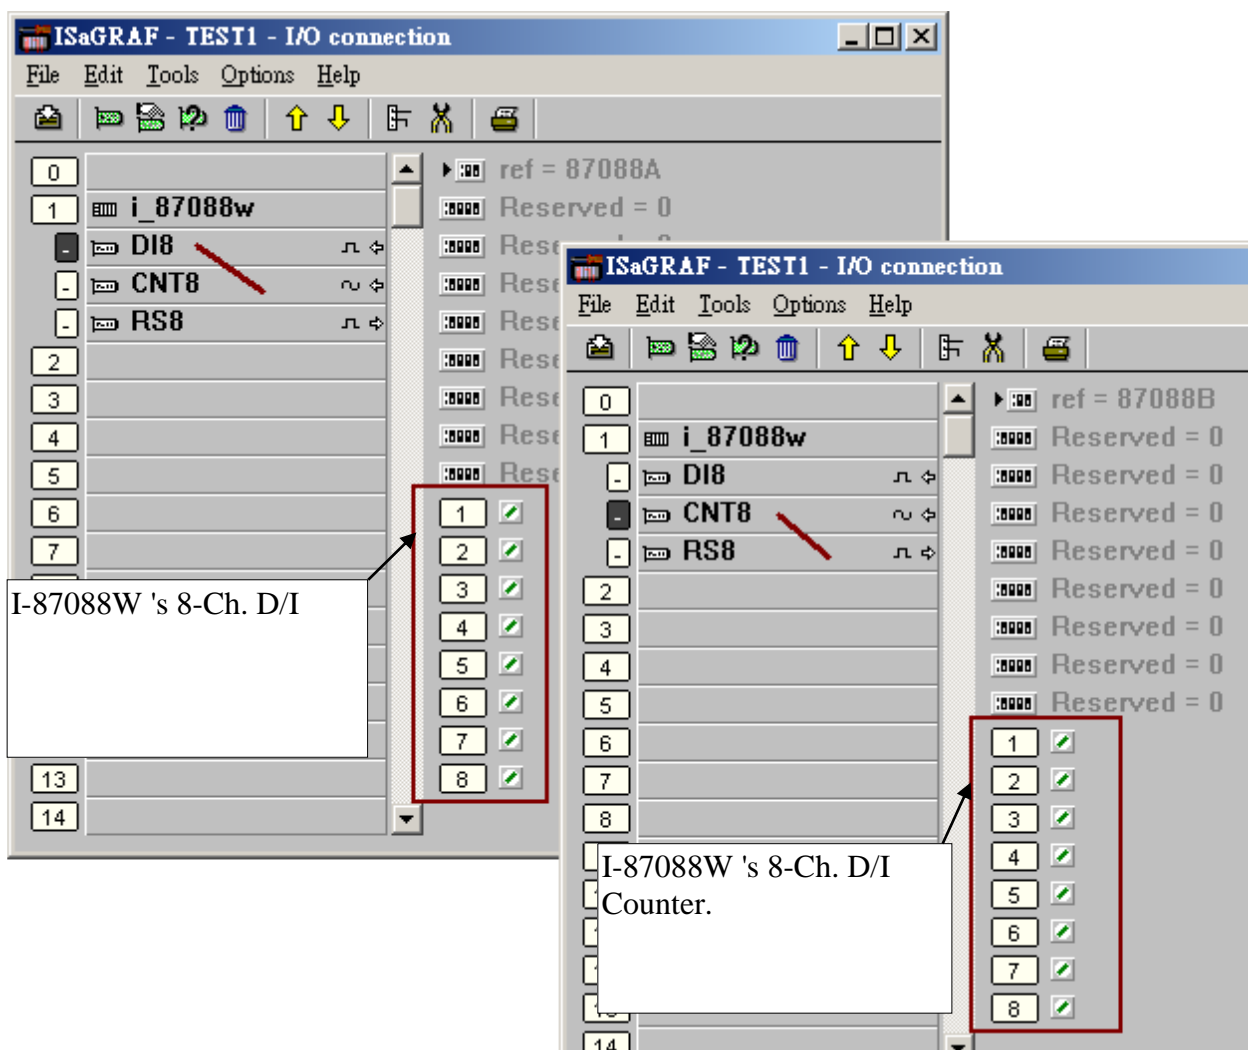

Classification	ISaGRAF FAQ-105						
Author	Chun Tsai	Version	1.0.0	Date	Aug. 2010	Page	8/ 11

Then using the C-function block “pwm87088” to control the PWM output for each channel.

Please must set the “ADR\_” as 0 (slot 0) or -1 (slot 1) to -7 (slot 7) for using I-87088W as local I/O module.


The “Freq\_” and “Duty\_” can be dynamically modified when the PWM mode is “Continuous” mode and “Run\_” is True (Started). The frequency and duty of the PWM output will change to the required value.

**Slot\_ must use a constant value.**  
0 (slot 0), -1 (slot 1) to -7 (slot 7)  
Setting as 1 to 255 means using it as a RS-485 remote I/O (refer to next page)

**Q\_ always returns True**  
so that many pwm87088  
can connect together

**Stat\_ is the current  
working state**  
True: working  
False: stopped

**Ch\_ must use a constant value 1 to 8**

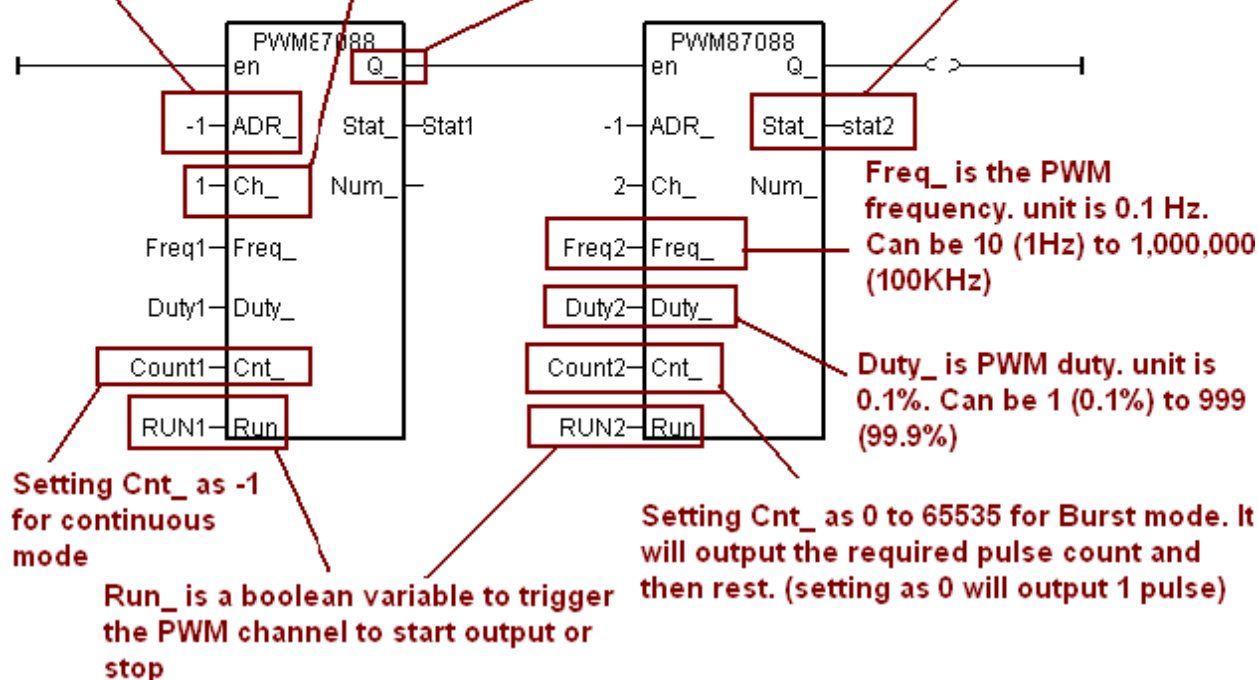




Classification	ISaGRAF FAQ-105						
Author	Chun Tsai	Version	1.0.0	Date	Aug. 2010	Page	9/ 11

### 1.3: Using I-87088W and I-7088 as RS-485 remote I/O

To use I-87088W or I-7088 as RS-485 remote I/O, first setting I-7088 and I-87088W as INIT mode and then running the PC/ DCON Utility to configure I-7088 and I-87088W once. Please must set proper "Address", "Communication Baud-rate" and "Checksum disabled or enabled" (default is disabled). And make sure the "D/I inverse" setting is disabled. (Disable the "D/I Inverse" means the ISaGRAF will read D/I value as False when there is no D/I signal, while read value as "True" when there is D/I signal input. **If this "D/I inverse" setting is mistaking enabled, please set I-7088 and I-87088 as INIT mode first, then run the DCON Utility to disable it (or you may send the "~00D00" command directly to it to disable the "D/I Inverse" setting)**)

To program the remote I-7088 (or I-87088W), first connecting the "bus7000b" in the ISaGRAF IO connection window. Set proper "com\_port", "com\_baud" and "checksum".

The ISaGRAF demo program is the "xpdmo75B". You may visit <http://www.icpdas.com/en/faq/index.php?kind=280#751> > FAQ-105 to download it. Then follow the steps listed in the section 9.5 of the ISaGRAF user's manual to restore the "wpdmo75.pia" to your PC/ ISaGRAF.

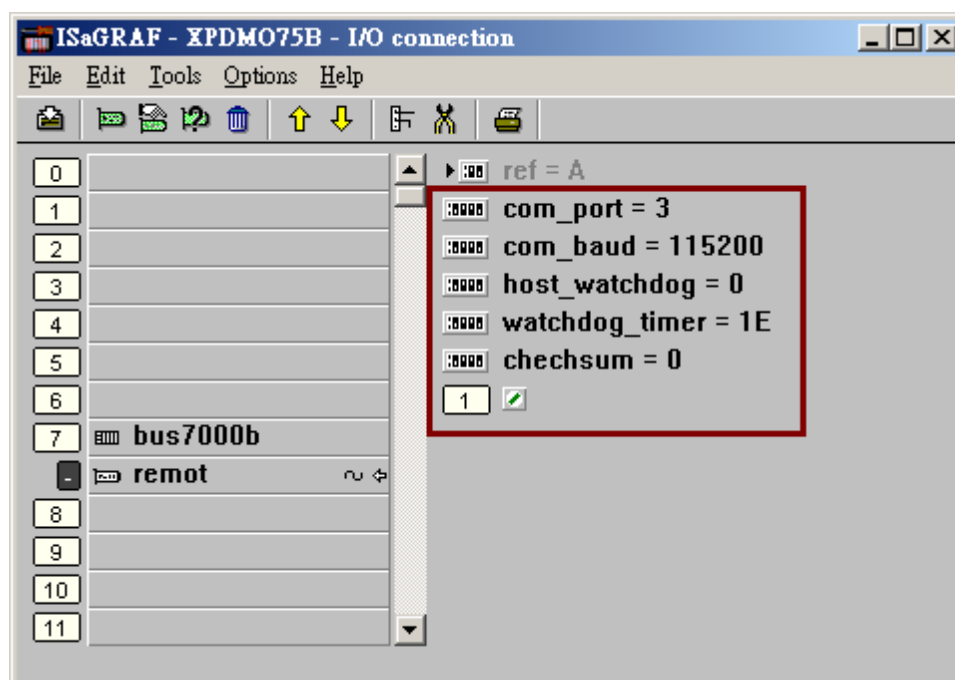


Classification	ISaGRAF FAQ-105						
Author	Chun Tsai	Version	1.0.0	Date	Aug. 2010	Page	10/ 11

Then using the “i\_87088” function-block to connect I-7088 (or I-87088W) on the upper position in the Ladder or function-block program.

(Please refer to the section 1.2 of this document for using I-87088W as local I/O module)

#### Address of the remote I/O module

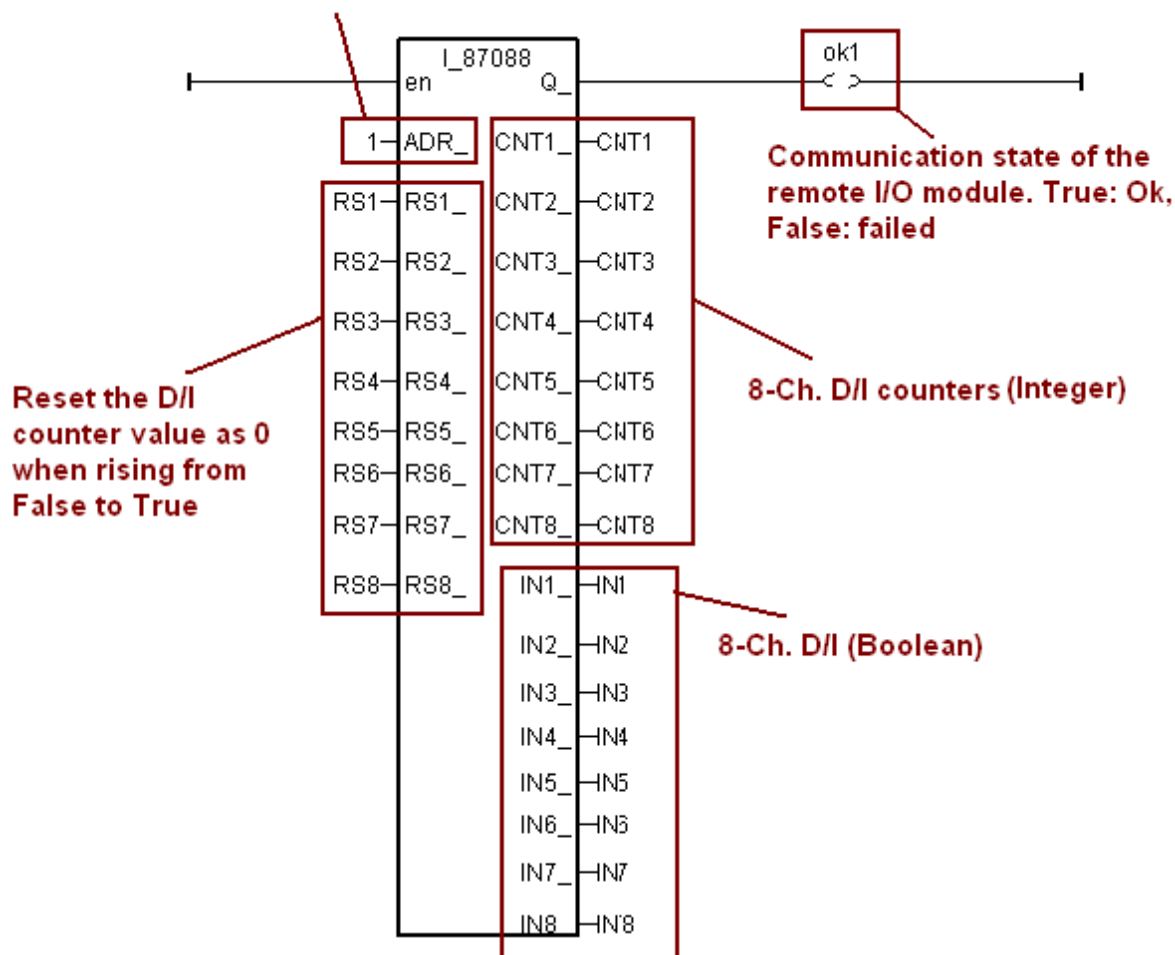

Classification	ISaGRAF FAQ-105						
Author	Chun Tsai	Version	1.0.0	Date	Aug. 2010	Page	11/ 11

Then using the C-function block “pwm87088” to control the PWM output for each channel.

Please must set the “ADR\_” as 1 (Addr. 1) to 255 (Addr. 255) for using I-87088W and I-7088 as RS-485 remote I/O module.

The “Freq\_” and “Duty\_” can be dynamically modified when the PWM mode is “Continuous” mode and “Run\_” is True (Started). The frequency and duty of the PWM output will change to the required value.

